

Chipsmall Limited consists of a professional team with an average of over 10 year of expertise in the distribution of electronic components. Based in Hongkong, we have already established firm and mutual-benefit business relationships with customers from, Europe, America and south Asia, supplying obsolete and hard-to-find components to meet their specific needs.

With the principle of "Quality Parts, Customers Priority, Honest Operation, and Considerate Service", our business mainly focus on the distribution of electronic components. Line cards we deal with include Microchip, ALPS, ROHM, Xilinx, Pulse, ON, Everlight and Freescale. Main products comprise IC, Modules, Potentiometer, IC Socket, Relay, Connector. Our parts cover such applications as commercial, industrial, and automotives areas.

We are looking forward to setting up business relationship with you and hope to provide you with the best service and solution. Let us make a better world for our industry!



Contact us

Tel: +86-755-8981 8866 Fax: +86-755-8427 6832

Email & Skype: info@chipsmall.com Web: www.chipsmall.com

Address: A1208, Overseas Decoration Building, #122 Zhenhua RD., Futian, Shenzhen, China








MCR-S-...-DCI

Current transducer up to 55 A, programmable and configurable


Data sheet 100241 en 11

© PHOENIX CONTACT 2012-06-07



1 Description

The MCR-S-...-DCI current transducers offer users the option of ordering a preconfigured device, configuring the device themselves via DIP switches or programming it with MCR/PI-CONF-WIN configuration software (Order No. 2814799).



The MCR-S-1-5-UI-DCI module provides not only the standard 1 A and 5 A input signals, but also the option of setting current ranges of 0 ... 0.2 A to 0 ... 11 A progressively.

With a measuring range of 0 \dots 9.5 A to 0 \dots 55 A, the MCR-S-10-50-UI-DCI is ideal for measuring higher motor currents.

DC, AC, and distorted currents can be equally well measured.

In addition to an analog output, these current transducers also have an optional relay and transistor output, e.g., for alarm monitoring.

When ordering, the desired configuration to which the device is to be adapted must be specified (see order key on page 6 and page 9).

Features

- Progressive adjustment of measuring range
- True r.m.s. value measurement
- 3-way electrical isolation according to EN 61010
- With optional relay and transistor output
- 22.5 mm ME housing



Observe the safety notes on page 11.



Make sure you always use the latest documentation.

It can be downloaded from the product at www.phoenixcontact.net/catalog.



This data sheet is valid for the products listed on the following page:



Table of contents

2

1	Desc	ription	1
2	Table	of contents	2
3	Orde	ring data	3
4	Tech 4.1 4.2	nical data	4
5	Desig	ın	10
6	Instal	lation and startup	11
	6.1	Safety notes	
	6.2	Method of operation	11
	6.3	Electrical connection	11
	6.4	Startup	12
	6.5	Configuration flowchart	12
7	Softw	are package (adapter)	18
8	Appli	cation examples	19
	8.1	Motor current measurement	
	8.2	Acquisition of motor current peak loads	
	8.3	Lighting monitoring	19

3 Ordering data

MCR current transducer, for measuring AC, DC, and distorted Currents

Description	Туре	Order No.	Pcs./Pkt.
Measuring range 0 A 0.2 A to 0 A 11 A			
Configured, with screw connection	MCR-S-1-5-UI-DCI ¹	2814634	1
Unconfigured, with screw connection	MCR-S-1-5-UI-DCI-NC	2814715	1
Measuring range 0 A 0.2 A to 0 A 11 A, with relay a	nd transistor output		
Configured, with screw connection	MCR-S-1-5-UI-SW-DCI ¹	2814650	1
Unconfigured, with screw connection	MCR-S-1-5-UI-SW-DCI-NC	2814731	1
Measuring range 0 A 9.5 A to 0 A 55 A			
Configured, with through connection	MCR-S-10-50-UI-DCI ¹	2814647	1
Unconfigured, with through connection	MCR-S10-50-UI-DCI-NC	2814728	1
Measuring range 0 A 9.5 A to 0 A 55 A, with relay a	nd transistor switching outp	ut	
Configured, with through connection	MCR-S-10-50-UI-SW-DCI ¹	2814663	1
Unconfigured, with through connection	MCR-S10-50-UI-SW-DCI-NC	2814744	1

¹ If no further details are given as to the configuration, the device is supplied in the standard configuration (see order key on page page 6 and page 9).

Accessories

Description	Туре	Order No.	Pcs./Pkt.
Configuration software	MCR/PI-CONF-WIN	2814799	1
Software adapter cable (stereo jack connector/25-pos. D-SUB) 1.2 m	MCR-TTL/RS232-E	2814388	1
Adapter cable, 9-pos. D-SUB female connector to 25-pos. D-SUB male connector	PSM-KAD 9 SUB 25/BS	2761295	1

4 Technical data

4.1 Technical data for MCR-S-1-5-UI(-SW)-DCI(-NC) (measuring range 0 A ... 0.2 A to 0 A ... 11 A)

Measuring input	MCR-S-1-5-UI-DCI (-NC)	MCR-S-1-5-UI-SW-DCI (-NC)			
Input current (AC, DC or distorted currents)	0 A	11 A			
Frequency range	15 Hz .	400 Hz			
Connection method	Screw termina	al block 2.5 mm ²			
Overload capacity, continuous	2 x	: I _{Nom}			
Surge strength for 1 s	20 x I _{Nom} (10	0 A, maximum)			
Output	MCR-S-1-5-UI-DCI (-NC)	MCR-S-1-5-UI-SW-DCI (-NC)			
Output current/load	0(4) mA 20 mA, 20	mA 0(4) mA / < 500 Ω			
Output voltage/load	0(1) V 5 V, 5 V	V 0(2) V /> 10 kΩ ' 0(1) V /> 10 kΩ 5 V /> 10 kΩ			
Switching output	MCR-S-1-5-UI-DCI (-NC)	MCR-S-1-5-UI-SW-DCI (-NC)			
Relay Output Contact material Max. switching voltage Continuous current load capacity	-	1 PDT AgSnO ₂ , hard gold-plated 30 V AC / 36 V DC 50 mA			
Transistor output Maximum transistor current Output voltage during event	-	PNP output 80 mA (not short-circuit-proof) 1 V under supply voltage			
Threshold setting	-	1 % 110 %			
Suppression time	-	0.1 s 20 s			
Threshold value switch status indicator	-	Yellow LED			
General data	MCR-S-1-5-UI-DCI (-NC)	MCR-S-1-5-UI-SW-DCI (-NC)			
Supply voltage		30 V DC			
Current consumption (without load)	Approximately 40 mA	Approximately 50 mA			
Transmission error of nominal value under nominal conditions:		0.5 %			
Measuring range nominal value: operate threshold from measuring range nominal value Input signal form: Measurement mode: Ambient temperature: Supply voltage:	0 A 1 2 50 H true r.n 2:	A/5 A/10 A 2 % z - sine n.s. value 3 °C V DC			
Temperature coefficient	< 0.0	025%/K			
Measuring rate		40 measurements/s with DC 5 measurements/s with AC			
Step response (10% 90 %)		with DC s with DC			
Safe isolation according to EN 50178, EN 61010					
Input/output (analog), input/output (relay), input/output (transistor), input/supply		C to ground 00 V AC three-phase networks)			

General data (continued)	MCR-S-1-5-UI-DCI (-NC)	MCR-S-1-5-UI-SW-DCI (-NC)		
Test voltage				
Input/output (analog), input/output (relay), input/output (transistor), input/supply	4 kV, 50	Hz, 1 min.		
Output (analog)/output (relay), output (relay)/output (transistor)	4 kV, 50	Hz, 1 min.		
Output (analog)/output (transistor), output (analog)/supply	500 V, 5	0 Hz, 1 min.		
Ambient temperature (operation)	-20 °C 60 °C			
Ambient temperature (storage/transport)	-40 °C 85 °C			
Module warm-up time	≥ 2 min.			
Supply voltage status indicator	Green LED			
Degree of protection	I	P20		
Mounting position	Any			
Mounting		Any		
Dimensions (W x H x D)	22.5 mm x 99 mm x 114.5 mm			
Housing material	Polyamide PA, non-reinforced			

Approvals				
CE	C€			
UL	PROCESS CONTROL EQUIPMENT FOR HAZARDOUS LOCATIONS 31ZN			
	CI. I Zn. 2, AEx nC IIC T6 / Ex nC IIC T6			
	Cl. I Div. 2, Groups A, B, C and D			
	A) This equipment is suitable for use in Class I, Division 2, Groups A, B, C and D or non-hazardous locations only.			
	B) Warning - explosion hazard - substitution of components may impair suitability for Class 1, Division 2.			
	C) Warning - explosion hazard - do not disconnect equipment unless power has been switched off or the area is known to be non-hazardous.			

Conformance with EMC Directive 2004/108/EC and Low Voltage Directive 2006/95/EC Noise immunity test according to EN 61000-6-2¹

Electrostatic discharge (ESD)	EN 61000-4-2	Criterion B ²	8 kV air discharge
Electromagnetic HF field	EN 61000-4-3	Criterion A ³	10 V/m
Fast transients (burst)	EN 61000-4-4	Criterion B ²	
Input/output/power supply			2 kV / 5 kHz
Surge current load (surge)	EN 61000-4-5	Criterion B ²	
Input/output			2 kV / 42 Ω
Supply			1 kV / 2 Ω
Conducted interference	EN 61000-4-6	Criterion A ³	
Input/output/power supply			10 V

Noise emission test according to EN 61000-6-4

9		
Noise emission of housing	EN 55011 ⁴	Class A ⁵

¹ EN 61000 corresponds to IEC 61000

² Criterion B: Temporary adverse effects on the operating behavior, which the device corrects automatically.

³ Criterion A: Normal operating behavior within the specified limits.

⁴ EN 55011 corresponds to CISPR11

⁵ Class A: Industrial application, without special installation measures.

Order Key for the MCR-S-1-5-UI(-SW)-DCI Current Transducer

If incorrect or no customer order information is given, the standard configuration is delivered (shown as an example in the ordering key).

Order	No.	Measuring Ran Value	ge Start		Range Final alue				Output signal		
2814	634 /	0.00	/	/ 5.00 /		OUT01					
MCR-S-1-5-UI-DCI 0 A 7.5 A 0.00 = 0 A				11 A D = 5 A		o	0 0	T01 = 0 mA 20 T02 = 4 mA 20 UT03 = 0 V 10 UT04 = 2 V 10 OUT05 = 0 V 5 V OUT06 = 1 V 5 V UT13 = -5 V +5 T14 = -10 V +1	m# V V V	A	
Order No.	Measuring RangeStart Value	Measuring Range Final Value	Output	signal	Threshold value		Suppression time		Switching beha trans		
2814650 /	0.00	5.00	ОПТ	01	50	/	3.0	/	Α	/	0
MCR-S-1-5- UI-SWI-DCI	0 A 7.5 A 0.00 = 0 A	0.2 A 11 A 5.00 = 5 A	OUT01 = 0 m OUT02 = 4 m		1 % 110 % 50 = 50 % of the		0.1 s 20 s 3.0 = 3 s		A = operating current- controlled		O = Above
			OUT03 = 0 OUT04 = 2 OUT05 = 0	V 10 V	set measuring range final value (here: 2.5 A)	-			R = Closed circuit current- controlled		U = Below
			OUT05 = 0 OUT06 = 1 OUT13 = -5 OUT14 = -10	V 5 V V +5 V		•					

4.2 Technical data for MCR-S-10-50-UI(-SW)-DCI(-NC) (measuring range 0 A ... 9.5 A to 0 A ... 55 A)

Measuring input	MCR-S-10-50-UI-DCI	MCR-S-10-50-UI-SW-DCI					
	(-NC)	(-NC)					
Input current (AC, DC or distorted currents)	0 A 55 A (freely adjustable)						
Frequency range		15 Hz 400 Hz					
Connection method		ection 10.5 mm Ø					
Overload capacity, continuous	·	n the conductor					
Current carrying capacity for 1 s	Depenas o	n the conductor					
Output	MCR-S-10-50-UI-DCI (-NC)	MCR-S-10-50-UI-SW-DCI (-NC)					
Output current/load	0(4) mA 20 mA, 20	mA 0(4) mA / < 500 Ω					
Output voltage/load	0(2) V 10 V, 10) V 0(2) V / > 10 kΩ					
	0(1) V 5 V, 5	V 0(1) V / > 10 kΩ					
	±10 V, ±	5 V / > 10 kΩ					
Switching output	MCR-S-10-50-UI-DCI (-NC)	MCR-S-10-50-UI-SW-DC					
Relay Output	-	1 PDT					
Contact material		AgSnO ₂ , hard gold-plated					
Max. switching voltage		30 V AC / 36 V DC					
Continuous current load capacity		50 mA					
Transistor output Maximum transistor current Output voltage during event		PNP output 80 mA (not short-circuit-proof) 1 V under supply voltage					
Threshold setting	-	1 % 110 %					
Suppression time	-	0.1 s 20 s					
Threshold value switch status indicator	-	Yellow LED					
General data	MCR-S-10-50-UI-DCI (-NC)	MCR-S-10-50-UI-SW-DCI (-NC)					
Supply voltage:	20 V D0	30 V DC					
Current consumption (without load)	Approximately 40 mA	Approximately 50 mA					
Current consumption (with transistor switching output: max. 80 mA)	Approximately 120 mA	Approximately 130 mA					
Transmission error of nominal value under nominal conditions:	<	0.5 %					
Measuring range nominal value: operate threshold from measuring range nominal value Input signal form: Measurement mode: Ambient temperature: Supply voltage:	(50 l true r. 2	50 A 0.8 % Hz - sine m.s. value 23 °C 4 V DC					
Temperature coefficient	< 0.	025%/K					
Measuring rate	40 measurements/s with DC 5 measurements/s with AC						
Step response (10% 90 %)	40 m	s with DC					
Safe isolation according to EN 50178, EN 61010	330 11	io marrio					

100241_en_11 PHOENIX CONTACT 7

Input/output (analog), input/output (relay), input/output (transistor), input/supply

300 V AC to ground (suitable for measuring in 400 V AC three-phase networks)

Input/output (analog), input/output (relay), input/output (transistor), input/supply Output (analog)/output (relay), output (relay), output (relay)/output (transistor) Output (analog)/output (transistor) Output (analog)/output (transistor) Output (analog)/output (transistor), output (analog)/supply 500 V, 50 Hz, 1 min. -20 °C 60 °C Ambient temperature (storage/transport) -40 °C 85 °C Module warm-up time Supply voltage status indicator Green LED Degree of protection Mounting position Any Mounting Dimensions (W x H x D) Housing material Approvals CE ⟨€	General data (continued)	MCR-S-10-50-UI-DCI MCR-S-10-50-UI-SW-DCI (-NC)
input/output (transistor), input/supply Output (analog)/output (relay), output (relay)/output (transistor) Output (analog)/output (transistor) Output (analog)/output (transistor), output (analog)/supply S00 V, 50 Hz, 1 min. -20 °C 60 °C	Test voltage	
output (relay)routput (transistor) Output (analog)/output (transistor), output (analog)/supply Ambient temperature (operation) Ambient temperature (storage/transport) -20 °C 60 °C Ambient temperature (storage/transport) -40 °C 85 °C Module warm-up time Supply voltage status indicator Degree of protection Mounting position Any Mounting Any Dimensions (W x H x D) -2.5 mm x 99 mm x 114.5 mm Polyamide PA, non-reinforced Approvals CE UL		4 kV, 50 Hz, 1 min.
Ambient temperature (operation) -20 °C 60 °C Ambient temperature (storage/transport) -40 °C 85 °C Module warm-up time Supply voltage status indicator Degree of protection Mounting position Mounting Dimensions (W x H x D) Housing material Approvals CE UL PROCESS CONTROL EQUIPMENT FOR HAZARDOUS LOCATIONS 31ZN CI. 1, Zn. 2, AEx nC IIC T6 / Ex nC IIC T6 CI. 1 Div. 2, Groups A, B, C and D A) This equipment is suitable for use in Class I, Division 2, Groups A, B, C and D or non-hazardous locations only. B) Warning - explosion hazard - substitution of components may impair suitability for Class 1, Division 2. C) Warning - explosion hazard - do not disconnect equipment unless power has been switched off or the area is known to be non-hazardous.		4 kV, 50 Hz, 1 min.
Ambient temperature (storage/transport) And °C 85 °C Module warm-up time Supply voltage status indicator Degree of protection Mounting position Any Mounting Dimensions (W x H x D) Housing material Approvals CE UL PROCESS CONTROL EQUIPMENT FOR HAZARDOUS LOCATIONS 312N CI. I, Zn. 2, AEx nC IIC T6 CI. I Div. 2, Groups A, B, C and D A) This equipment is suitable for use in Class I, Division 2, Groups A, B, C and D or non-hazardous locations only. B) Warning - explosion hazard - do not disconnect equipment unless power has been switched off or the area is known to be non-hazardous.	Output (analog)/output (transistor), output (analog)/supply	500 V, 50 Hz, 1 min.
Module warm-up time Supply voltage status indicator Degree of protection Mounting position Mounting Dimensions (W x H x D) Housing material Approvals CE UL PROCESS CONTROL EQUIPMENT FOR HAZARDOUS LOCATIONS 31ZN CI. I, Zn. 2, AEx nc IIC T6 / Ex nc IIC T6 CI. I Div. 2, Groups A, B, C and D A) This equipment is suitable for use in Class I, Division 2, Groups A, B, C and D or non-hazardous locations only. B) Warning - explosion hazard - substitution of components may impair suitability for Class 1, Division 2. C) Warning - explosion hazard - do not disconnect equipment unless power has been switched off or the area is known to be non-hazardous.	Ambient temperature (operation)	-20 °C 60 °C
Supply voltage status indicator Degree of protection Mounting position Mounting Dimensions (W x H x D) Housing material Approvals CE UL PROCESS CONTROL EQUIPMENT FOR HAZARDOUS LOCATIONS 31ZN CI. 1, Zn. 2, AEx nC IIC T6 / Ex nC IIC T6 CI. 1 Div. 2, Groups A, B, C and D A) This equipment is suitable for use in Class I, Division 2, Groups A, B, C and D or non-hazardous locations only. B) Warning - explosion hazard - substitution of components may impair suitability for Class 1, Division 2. C) Warning - explosion hazard - do not disconnect equipment unless power has been switched off or the area is known to be non-hazardous.	Ambient temperature (storage/transport)	-40 °C 85 °C
Degree of protection Mounting position Any Mounting Dimensions (W x H x D) Housing material Approvals CE CE CE CI PROCESS CONTROL EQUIPMENT FOR HAZARDOUS LOCATIONS 31ZN CI. 1, Zn. 2, AEx nC IIC T6 / Ex nC IIC T6 CI. 1 Div. 2, Groups A, B, C and D A) This equipment is suitable for use in Class 1, Division 2, Groups A, B, C and D or non-hazardous locations only. B) Warning - explosion hazard - substitution of components may impair suitability for Class 1, Division 2. C) Warning - explosion hazard - do not disconnect equipment unless power has been switched off or the area is known to be non-hazardous.	Module warm-up time	≥ 2 min.
Mounting position Mounting Dimensions (W x H x D) Housing material Approvals CE UL PROCESS CONTROL EQUIPMENT FOR HAZARDOUS LOCATIONS 31ZN CI. I, Zn. 2, AEx nC IIC T6 CI. I Div. 2, Groups A, B, C and D A) This equipment is suitable for use in Class I, Division 2, Groups A, B, C and D or non-hazardous locations only. B) Warning - explosion hazard - substitution of components may impair suitability for Class 1, Division 2. C) Warning - explosion hazard - do not disconnect equipment unless power has been switched off or the area is known to be non-hazardous.	Supply voltage status indicator	Green LED
Mounting Dimensions (W x H x D) 22.5 mm x 99 mm x 114.5 mm Polyamide PA, non-reinforced Approvals CE UL PROCESS CONTROL EQUIPMENT FOR HAZARDOUS LOCATIONS 31ZN CI. I, Zn. 2, AEx nC IIC T6 / Ex nC IIC T6 CI. I Div. 2, Groups A, B, C and D A) This equipment is suitable for use in Class I, Division 2, Groups A, B, C and D or non-hazardous locations only. B) Warming - explosion hazard - substitution of components may impair suitability for Class 1, Division 2. C) Warming - explosion hazard - do not disconnect equipment unless power has been switched off or the area is known to be non-hazardous.	Degree of protection	IP20
Dimensions (W x H x D) 22.5 mm x 99 mm x 114.5 mm Polyamide PA, non-reinforced Approvals CE UL PROCESS CONTROL EQUIPMENT FOR HAZARDOUS LOCATIONS 31ZN CI. I, Zn. 2, AEx nC IIC T6 / Ex nC IIC T6 CI. I Div. 2, Groups A, B, C and D A) This equipment is suitable for use in Class I, Division 2, Groups A, B, C and D or non-hazardous locations only. B) Warning - explosion hazard - substitution of components may impair suitability for Class 1, Division 2. C) Warning - explosion hazard - do not disconnect equipment unless power has been switched off or the area is known to be non-hazardous.	Mounting position	Any
Housing material Approvals CE UL PROCESS CONTROL EQUIPMENT FOR HAZARDOUS LOCATIONS 31ZN CI. I, Zn. 2, AEx nC IIC T6 / Ex nC IIC T6 CI. I Div. 2, Groups A, B, C and D A) This equipment is suitable for use in Class I, Division 2, Groups A, B, C and D or non-hazardous locations only. B) Warning - explosion hazard - substitution of components may impair suitability for Class 1, Division 2. C) Warning - explosion hazard - do not disconnect equipment unless power has been switched off or the area is known to be non-hazardous.	Mounting	Any
Approvals CE UL PROCESS CONTROL EQUIPMENT FOR HAZARDOUS LOCATIONS 31ZN CI. I, Zn. 2, AEx nC IIC T6 / Ex nC IIC T6 CI. I Div. 2, Groups A, B, C and D A) This equipment is suitable for use in Class I, Division 2, Groups A, B, C and D or non-hazardous locations only. B) Warning - explosion hazard - substitution of components may impair suitability for Class 1, Division 2. C) Warning - explosion hazard - do not disconnect equipment unless power has been switched off or the area is known to be non-hazardous.	Dimensions (W x H x D)	22.5 mm x 99 mm x 114.5 mm
CE UL PROCESS CONTROL EQUIPMENT FOR HAZARDOUS LOCATIONS 31ZN CI. I, Zn. 2, AEx nC IIC T6 / Ex nC IIC T6 CI. I Div. 2, Groups A, B, C and D A) This equipment is suitable for use in Class I, Division 2, Groups A, B, C and D or non-hazardous locations only. B) Warning - explosion hazard - substitution of components may impair suitability for Class 1, Division 2. C) Warning - explosion hazard - do not disconnect equipment unless power has been switched off or the area is known to be non-hazardous.	Housing material	Polyamide PA, non-reinforced
PROCESS CONTROL EQUIPMENT FOR HAZARDOUS LOCATIONS 31ZN CI. I, Zn. 2, AEx nC IIC T6 / Ex nC IIC T6 CI. I Div. 2, Groups A, B, C and D A) This equipment is suitable for use in Class I, Division 2, Groups A, B, C and D or non-hazardous locations only. B) Warning - explosion hazard - substitution of components may impair suitability for Class 1, Division 2. C) Warning - explosion hazard - do not disconnect equipment unless power has been switched off or the area is known to be non-hazardous.	Approvals	
LOCATIONS 31ZN CI. I, Zn. 2, AEx nC IIC T6 / Ex nC IIC T6 CI. I Div. 2, Groups A, B, C and D A) This equipment is suitable for use in Class I, Division 2, Groups A, B, C and D or non-hazardous locations only. B) Warning - explosion hazard - substitution of components may impair suitability for Class 1, Division 2. C) Warning - explosion hazard - do not disconnect equipment unless power has been switched off or the area is known to be non-hazardous.	CE	CE
CI. I Div. 2, Groups A, B, C and D A) This equipment is suitable for use in Class I, Division 2, Groups A, B, C and D or non-hazardous locations only. B) Warning - explosion hazard - substitution of components may impair suitability for Class 1, Division 2. C) Warning - explosion hazard - do not disconnect equipment unless power has been switched off or the area is known to be non-hazardous.	UL	PROCESS CONTROL EQUIPMENT FOR HAZARDOUS LOCATIONS 31ZN
A) This equipment is suitable for use in Class I, Division 2, Groups A, B, C and D or non-hazardous locations only. B) Warning - explosion hazard - substitution of components may impair suitability for Class 1, Division 2. C) Warning - explosion hazard - do not disconnect equipment unless power has been switched off or the area is known to be non-hazardous.		CI. I, Zn. 2, AEx nC IIC T6 / Ex nC IIC T6
Groups A, B, C and D or non-hazardous locations only. B) Warning - explosion hazard - substitution of components may impair suitability for Class 1, Division 2. C) Warning - explosion hazard - do not disconnect equipment unless power has been switched off or the area is known to be non-hazardous.		Cl. I Div. 2, Groups A, B, C and D
suitability for Class 1, Division 2. C) Warning - explosion hazard - do not disconnect equipment unless power has been switched off or the area is known to be non-hazardous.		
power has been switched off or the area is known to be non-hazardous.		
Conformance with EMC Directive 2004/108/EG and Low Voltage Directive 2006/95/EG		
Conformance with EMC Directive 2004/108/EG and Low Voltage Directive 2006/95/EG		
	Conformance with EMC Directive 2004/108/EG	and Low Voltage Directive 2006/95/EG

Noise emission test according to EN 61000-6-4

Noise emission of housing	EN	55011 ⁴	Class A ⁵

¹ EN 61000 corresponds to IEC 61000

² Criterion B: Temporary adverse effects on the operating behavior, which the device corrects automatically.

³ Criterion A: Normal operating behavior within the specified limits.

⁴ EN 55011 corresponds to CISPR11

⁵ Class A: Industrial application, without special installation measures.

Order Key for the MCR-S-10-50-UI(-SW)-DCI current transducer

If incorrect or no customer order information is given, the standard configuration is delivered (shown as an example in the ordering key).

Order	No.	Measuring range	start value Measuring	range final value		Output signal	
2814	647	0.0	/	50.0		OUT01	
MCR-S-10-	50-UI-DCI	0 A 37.5 0.0 = 0 A		A 55 A .0 = 50 A	OI (JT01 = 0 mA 20 n JT02 = 4 mA 20 n DUT03 = 0 V 10 v DUT04 = 2 V 10 v OUT05 = 0 V 5 V OUT06 = 1 V 5 V OUT13 = -5 V +5 v JT14 = -10 V +10	nA '
Order No.	Measuring rangestart value	Measuring range final value	Output signal	Threshold value	Suppression time	Switching behav trans	
2814663 /	0.0	50.0	OUT01	/ 50	/ 3.0	' A /	0
MCR-S-10-50 -UI-SWI-DCI	0 A 37.5 A 0.0 = 0 A	9.5 A 55 A 50.0 = 50 A	OUT01 = 0 mA 20 mA OUT02 = 4 mA 20 mA OUT03 = 0 V 10 V		0.1 s 20 s 3.0 = 3 s	A = Operating current- controlled R = Closed	O = Above
			OUT04 = 2 V 10 V OUT05 = 0 V 5 V OUT06 = 1 V 5 V OUT13 = -5 V +5 V OUT14 = -10 V +10 V	range final value (here: 25 A)		circuit current- controlled	U = Below

5 Design

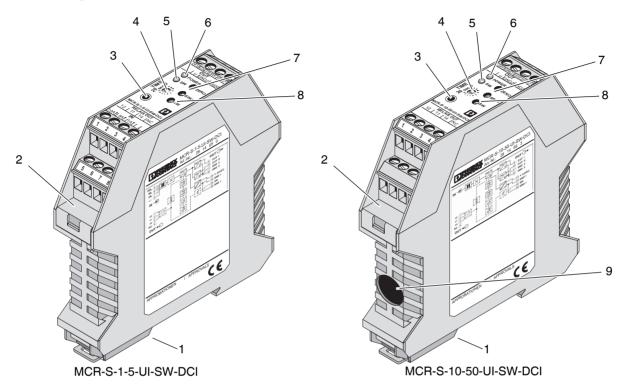


Figure 1 Structure using the example of the MCR-S-...-UI-SW-DCI(-NC) current transducer with relay and transistor output

- 1 Metal lock for mounting on the DIN rail
- 2 Upper part of housing slides open for DIP switch setting
- 3 Programming interface
- 4 TIME potentiometer for threshold value suppression time (only for MCR-S-...-UI-SW-DCI(-NC))
- 5 "SW" LED (yellow): Threshold value switch (only for MCR-S-...-UI-SW-DCI(-NC))
- 6 "POWER" LED (green): Supply voltage
- 7 ZERO/SPAN potentiometer
- 8 Threshold value potentiometer (only for MCR-S-...-UI-SW-DCI(-NC))



The potentiometers on the front should only be adjusted using a screwdriver, which is safely isolated from the voltage at the input.

9 Cable feed-through (only for MCR-S-10-50-UI(-SW)-DCI(-NC))

6 Installation and startup

6.1 Safety notes



During operation, certain parts of this electric measuring transducer may carry hazardous voltages. Disregarding this warning may result in serious personal injury or damage to property.

MCR-S-...-DCI Modules must only be installed and started by qualified personnel.

Qualified personnel are people who, because of their education, experience and instruction and their knowledge of relevant standards, regulations, accident prevention and service conditions, have been authorized by those responsible for the safety of the plant, to carry out any required operations and who are able to recognize and avoid any possible dangers.



The transducer must not be started up when the housing is open.



The potentiometers on the front should only be adjusted using a screwdriver, which is safely isolated from the voltage at the input.



For applications with high operating voltages, ensure sufficient distance or insulation and provide shock protection.

Safe and error-free operation of this device can only be ensured if transport, storage, and assembly are carried out correctly and operation and maintenance are carried out with care.

6.2 Method of operation

Connection to the input terminal blocks (MCR-S-1-5-...-DCI) or passing the live conductor through the current transducer (MCR-S-10-50-...-DCI) induces a magnetic flux in the stripwound core. The magnetic flux density is measured using a Hall sensor and converted proportionally from the input current to a voltage (Hall voltage). A subsequent true r.m.s. value converter enables DC, AC, and distorted currents to be measured. The signal is amplified for further processing and made available as a proportional analog signal at the output.

6.3 Electrical connection



When operating this electric measuring transducer, the national regulations (e.g., in Germany, VDE 0100 "Conditions for the Erection of Electrical Power Installations with Nominal Voltages Below 1000 V") must be observed during the installation and selection of the electrical conductors.

Pin assignment

	-
Connection	Description
terminal	
block	
1	(12) N/C contact ¹
2	(11) Center contact ¹
3	(14) N/O contact ¹
4	Not used
5	10 A input ²
6	5 A input ²
7	1 A input ²
8	Reference ground for 1, 5, and 10 A input ²
9	Current output
10	Voltage output
11	Reference ground for current or voltage
	output
12	Reference ground for current or voltage
	output
13	Operating voltage (+24 V DC)
14	Reference ground for operating voltage
15	Transistor output ¹
16	Reference ground for transistor output ¹

¹ Only for MCR-S-...-SW-DCI(-NC)

² Only for MCR-S-1-5-(-SW)-DCI(-NC)

6.4 Startup

Before starting up the measuring transducer, please ensure that the module configuration data matches the measuring requirements. The configuration data for a preconfigured device can be found on the right hand side of the housing.

If you are using an unconfigured transducer, there is a standard configuration which can be found in the order keys on page 6 and page 9. If the desired configuration does not match the label on the side of the housing or the standard configuration, refer to the section below.

6.5 Configuration flowchart

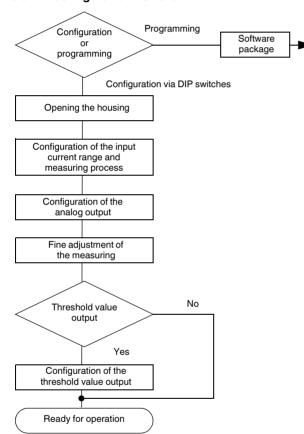


Figure 2 Configuration flowchart

6.5.1 Configuration or programming

The MCR-S-...-DCI generation offers the advantage of a choice between configuration and programming. MCR/PI-CONF-WIN software can be used to freely program the true r.m.s. value current transducer.

Programming is explained in the software manual. The user-friendly configuration software runs under all popular Windows operating systems.

In addition to programming, modules can be parameterized using DIP switches and potentiometers.

The rest of this section deals with configuration:

6.5.2 Opening the housing



The transducer must not be started up when the housing is open.

Release the locked upper part of the housing on both sides with the help of a screwdriver. The upper part of the housing and the electronics can now be pulled out approximately 3 cm.

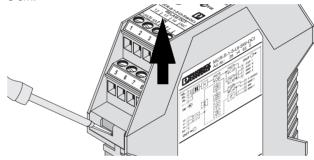


Figure 3 Opening the housing

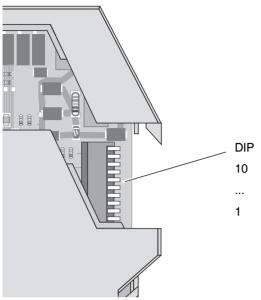


Figure 4 DIP switches

DIP	Description	
10	Configuration via DIP switches/	
10	programming via software	
9	Input current measurement: True r.m.s.	
	value/arithmetic average value	
8	Operating current/closed circuit current	
0	behavior ¹	
7	Above threshold value/	
,	Below threshold value ¹	
6		
5	Catting the english system teleprop	
4	Setting the analog output signal	
3		
2	Cotting the input property in a very	
1	Setting the input measuring range	

¹ Only for MCR-S-...-SW-DCI(-NC)

Setting DIP switch 10 to configuration mode (DIP switch 10 to "OFF") switches all potentiometers to "active".

DIP 10	Description
OFF	Configuration via DIP switches
ON	Programming via software (DIP switches 1 to 9 and potentiometer settings not relevant)

6.5.3 Configuration of the input current range and measuring process

(Rough setting via DIP switches)

Use DIP switch 9 to select the measuring process (true r.m.s. value or arithmetic average value).

DIP 9	Description
OFF	True r.m.s. value (AC and DC without without sign bitdetection)
ON	Arithmetic average value (DC with sign bitdetection)

True r.m.s. value: The true r.m.s. value of an AC current corresponds by definition to the steady-state value that results from the instantaneous values of this current. This steady-state value generates the same thermal work in an ohmic resistor as a DC current of identical magnitude. The term "true r.m.s. value" simply indicates that distorted and pulsating currents are also measured.

Arithmetic average value: The arithmetic average value is used to measure DC currents or to filter a DC portion from a pulsating current. Using the arithmetic average value on a symmetrical AC current would result in the measured value being "0".

The arithmetic average value can be used to make bipolar DC currents available as analog standard signals at the output.

MCR-S-1-5-...DCI: Optimum use of the measuring ranges

SPAN potentio- meter -25%	Nominal range ¹	SPAN potentio- meter +25%	DIP 1	DIP 2
1 A input: Mea	asuring range:	0 A 0.18 A to	0 A1	I.1 A
0 A 0.75 A	0 A 1.00 A	0 A 1.10 A	OFF	OFF
0 A 0.48 A	0 A 0.65 A	0 A 0.81 A	OFF	ON
0 A 0.30 A	0 A 0.40 A	0 A 0.50 A	ON	OFF
0 A 0.18 A	0 A 0.25 A	0 A 0.31 A	ON	ON
5 A input: Measuring range: 0 0.94 A to 0 5.5 A			4	
0 A 3.75 A	0 A 5.00 A	0 A 5.50 A	OFF	OFF
0 A 2.43 A	0 A 3.25 A	0 A 4.06 A	OFF	ON
0 A 1.50 A	0 A 2.00 A	0 A 2.50 A	ON	OFF
0 A 0.94 A	0 A 1.25 A	0 A 1.56 A	ON	ON
10 A input: Measuring range: 0 4.87 A to 0 11 A				
0 A 7.50 A	0 A 10.0 A	0 A 11.00 A	OFF	OFF
0 A 4.87 A	0 A 6.5 A	0 A 8.12 A	OFF	ON

¹ The nominal range is adapted

MCR-S-10-50-...DCI: Optimum use of the measuring range

SPAN potentio- meter -25%	Nominal range ¹	SPAN potentio- meter +25%	DIP 1	DIP 2
Measuring ran	ge: 0 A 9.38	A to 0 A 55 A	1	
0 A 37.5 A	0 A 50.0 A	0 A 55.0 A	OFF	OFF
0 A 24.4 A	0 A 32.5 A	0 A 40.6 A	OFF	ON
0 A 15.0 A	0 A 20.0 A	0 A 25.0 A	ON	OFF
0 A 9.38 A	0 A 12.5 A	0 A 15.6 A	ON	ON

¹ The nominal range is adapted

6.5.4 Configuration of the analog output

Output	DIP 3	DIP 4	DIP 5	DIP 6
0 mA 20 mA	OFF	OFF	OFF	OFF
20 mA 0 mA	OFF	OFF	OFF	ON
4 mA 20 mA	OFF	OFF	ON	OFF
20 mA 4 mA	OFF	OFF	ON	ON
0 V 10 V	OFF	ON	OFF	OFF
10 V 0 V	OFF	ON	OFF	ON
0 V 5 V	OFF	ON	ON	OFF
5 V 0 V	OFF	ON	ON	ON
1 V 5 V	ON	OFF	ON	OFF
5 V 1 V	ON	OFF	ON	ON
-10 V 10 V	ON	ON	OFF	OFF
10 V10 V	ON	ON	OFF	ON
-5 V 5 V	ON	ON	ON	OFF
5 V5 V	ON	ON	ON	ON

6.5.5 Configuration of the Threshold Value Output

The relay and transistor output of the threshold value versions (MCR-S-...-SW-DCI) are set after the input measuring range and the analog output have been adapted.

Setting the switching threshold

The diagrams below (Figure 5 to Figure 8 on page 15) illustrate the four possible switching behavior options for the relay and transistor output. The various options for the operating behavior in threshold value mode are divided according to:

- Operating current or closed circuit current principle
- Threshold value triggered when value is below threshold
- Value is above threshold value

If necessary, the corresponding switching behavior can be set via DIP switch 7 and DIP switch 8.

DIP 7	DIP 8	Switching Behavior of Relay and Transistor Output	See
OFF	OFF	Operating current-controlled when above threshold value	Figure 5
ON	OFF	Operating current-controlled when below threshold value	Figure 6
OFF	ON	Closed circuit current-controlled when above threshold value	Figure 7
ON	ON	Closed circuit current-controlled when below threshold value	Figure 8

Switching behavior of relay and transistor output for the current transducer

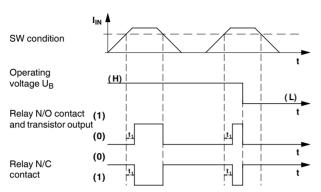


Figure 5 Function diagram: Operating currentcontrolled when above threshold value

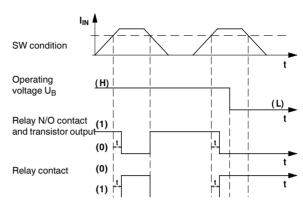


Figure 6 Function diagram: Closed circuit currentcontrolled when above threshold value

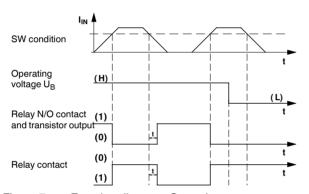


Figure 7 Function diagram: Operating currentcontrolled when below threshold value

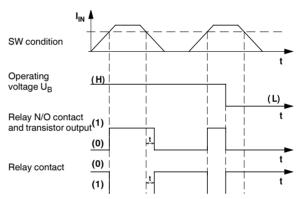


Figure 8 Function diagram: Closed circuit currentcontrolled when below threshold value

- (0) = N/O contact and transistor open, N/C contact closed, LED off
- (1) = N/O contact and transistor closed, N/C contact open, LED on

t₁ can be set via software and potentiometer

Fine adjustment of the measuring transducer

- Close the module after roughly setting the input current range and preselecting the output signal.
- Connect the module to the signal lines and the operating voltage according to the instructions in "Electrical connection" on page 11.

When the green "POWER" LED is lit, the operating voltage of 20 V DC \dots 30 V DC is connected.



When using the MCR-S-...-DCI, ensure you use the correct signal input terminal block for your measuring range.

Signal input range	Signal input terminal block	Ground terminal block
1 A	7	8
5 A	6	8
10 A	5	8



Allow the module to warm up for 2 minutes before starting the adjustment procedure.






Figure 9 Potentiometers

ZERO and SPAN behavior (±25% each) are shown in Figure 10 and Figure 11:

- ZERO potentiometer for zero point adjustment
- SPAN potentiometer for final value adjustment




Figure 10 Offset (ZERO) behavior




Figure 11 Final value (SPAN) behavior

Adjustment structure




Figure 12 Adjustment structure

- After connecting the operating voltage and signal lines. first adjust the zero point (offset). There should be no signal at the input $(I_F = 0)$.
- The analog output must correspond to a preselected output signal from the table on page 14. Adjust any inaccuracies using the ZERO potentiometer.
- To adjust the measuring range final value, a current should be specified which is the same level as the final value if possible. If this is not possible, one of the following adjustment formulae should be used:

$$I_A = I_0 + (\frac{I_E}{I_{ME}} * (I_{MA} - I_0))$$
 $U_A = U_0 + (\frac{I_E}{I_{ME}} * (U_{MA} - U_0))$

Example:

The current transducer is to be set to the following values:

Input measuring range: 0 A ... 5 A

 $I_{MF} = 5 A$

Output measuring range: 0 mA ... 20 mA

 $I_0 = 0 \text{ mA}$

I_{MA} = 20 mA

Constant current for configuration

 $I_F = 3A$

Adjust the calculated output current using the SPAN potentiometer to $I_A = 12$ mA. When the voltage output is used, the same adjustment procedure is necessary.

Threshold value output

- Specify a current for the module, which corresponds to the threshold value:
- Set the TIME potentiometer to "0 s" and turn the threshold value potentiometer according to the following instructions (see Figure 5 to Figure 8 on page 15):
- For Figure 5: Turn the threshold value potentiometer until the yellow "SW" LED lights up.
- For Figure 6: Turn the threshold value potentiometer until the yellow "SW" LED goes out.
- For Figure 7: Turn the threshold value potentiometer until the yellow "SW" LED goes out.
- For Figure 8: Turn the threshold value potentiometer until the yellow "SW" LED lights up.
- To prevent switching behavior at the binary output level during a brief overcurrent, a suppression time must be set using the TIME potentiometer. If the increased current is present for longer than the specified suppression time, the preselected switching behavior becomes active. The available setting range is 0 to 20 seconds.

When the yellow "SW" LED lights up (relay and transistor status display), the N/O contact of the PDT contact is closed and the N/C contact of the PDT contact is opened. The transistor output switches through.

PHOENIX CONTACT 17 100241_en_11

7 Software package (adapter)





As an alternative to setting via DIP switches, the module can be programmed using the MCR/PI-CONF-WIN configuration software (Order No. 2814799).

Software features

- All configuration parameters can be entered in the computer
- The parameters entered in the computer can be saved to the measuring transducer
- The parameters available in the module can be exported
- The parameters can be saved to a drive of your choice
- A side-panel label can be created
- The programmed module parameters can be printed
- Bar graph display
- Monitoring function

The MCR-TTL/RS232-E software adapter cable (Order No. 2814388) can be used to connect the computer and the current transducer. This cable has a stereo jack connector on one end for connection to the current transducer and a 25-pos. D-SUB female connector on the other end for connection to a computer. For connection to the computer, an adapter cable for the interface converter is usually required (9-pos. D-SUB female connector to 25-pos. D-SUB male connector, Order No. 2761295).









8 Application examples

8.1 Motor current measurement

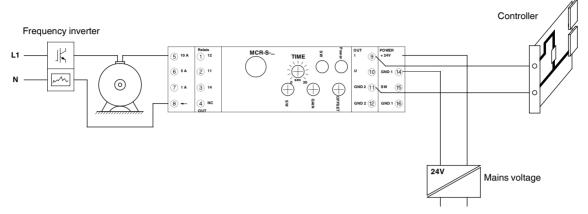


Figure 13 Motor current measurement

The use of MCR-S-...-DCI modules in one or more supply phases of the motor enables what is known as "motor monitoring" (Figure 13). The MCR current transducer can transfer corresponding standard signals about the motor load to the control system or service personnel. The true r.m.s. value measurement process means that AC, DC, and distorted currents can be measured. Even higher frequency currents up to 1 kHz can be acquired.

8.2 Acquisition of motor current peak loads

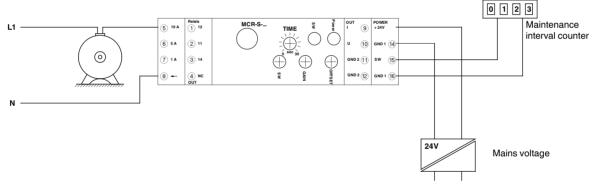


Figure 14 Acquisition of motor current peak loads

Large industrial motors must be overhauled and serviced at regular intervals. Installing an MCR current transducer in one phase of the motor feed line enables pulses to be generated with the relay or transistor switching output that can be measured using a simple meter (Figure 14). The service personnel can then use the motor starts and peak loads as a basis to provide efficient maintenance corresponding to the number of overloads.

8.3 Lighting monitoring

MCR current transducers can be used for monitoring lighting. If the strength of the current in a circuit is above or below a specified value after a suppressed switch-on time, there is a fault in the lighting circuit. If the lighting circuit fails, this signal status can be passed on to another control unit and the emergency lighting can be switched on. The same method can also be used with other power loads.