



Chipsmall Limited consists of a professional team with an average of over 10 year of expertise in the distribution of electronic components. Based in Hongkong, we have already established firm and mutual-benefit business relationships with customers from,Europe,America and south Asia,supplying obsolete and hard-to-find components to meet their specific needs.

With the principle of “Quality Parts,Customers Priority,Honest Operation,and Considerate Service”,our business mainly focus on the distribution of electronic components. Line cards we deal with include Microchip,ALPS,ROHM,Xilinx,Pulse,ON,Everlight and Freescale. Main products comprise IC,Modules,Potentiometer,IC Socket,Relay,Connector.Our parts cover such applications as commercial,industrial, and automotives areas.

We are looking forward to setting up business relationship with you and hope to provide you with the best service and solution. Let us make a better world for our industry!



Contact us

Tel: +86-755-8981 8866 Fax: +86-755-8427 6832

Email & Skype: info@chipsmall.com Web: www.chipsmall.com

Address: A1208, Overseas Decoration Building, #122 Zhenhua RD., Futian, Shenzhen, China



Conductive Sensors

1-point Basic Level Controller

Type CL with Potentiometer and Time Control

CARLO GAVAZZI



- Conductive level controller
- Sensitivity adjustment 5 K Ω to 150 K Ω
- For filling or emptying applications
- Low-voltage AC electrodes
- Easy installation on DIN rails 17.5 mm
- Rated operational voltage: 24 VAC/DC
- Output 8A/250 VAC SPST relay
- LED indication for: Output ON, Power ON



Product Description

μ -Processor based level controller for liquids with a wide sensitivity range from 5 K Ω to 150 K Ω .

One probe level control with built in ON or OFF time delay for filling or emptying applications. The time delay can be set from 1 to 30 seconds.

Ordering Key

CLD1EA1CM24

Type _____
 DIN rail mounting _____
 Inputs _____
 Function _____
 Adjustment _____
 Outputs _____
 Relay versions _____
 Power supply _____

Type Selection

Mounting

DIN-rail

Ordering no.

Supply: 24 VAC/DC

CLD1EA1CM24

Specifications

Rated operational voltage (U_B)		Rated impulse withstand volt.	
Supply class	2	4 kV (1.2/50 μ S) (contacts / electronics) (IEC 664)	
Pin A1 & A2	24	Operating frequency (f) max	
Rated insulation voltage	<2.0 kVAC (rms)	Relay output	
Rated impulse withstand voltage	4 kV (1.2/50 μ S) (line/neutral)	0.5 HZ	
Rated operational power		Response time	
AC/DC supply	5 VA / 5 W	OFF-ON (t _{on})	
Delay on operate (t_v)		ON-OFF (t _{off})	
< 300 mS		1 sec to 30 sec adjustable	
Outputs		Environment	
Rated insulation voltage	250 VAC (rms) (cont./elec.)	Overvoltage category	
Relay Rating (AgCdO)		Degree of protection	
Resistive loads	AC1	Pollution degree	
		III (IEC 60664)	
		IP 20 (IEC 60529, 60947-1)	
		2 (IEC 60664/60664A, 60947-1)	
Small induc. Loads	AC15	Temperature	
		Operating	
		Storage	
		-20° to +50°C (-4° to +122°)	
Mechanical life (typical)		-50° to +85°C (-58° to +185°F)	
		Housing material	
Electrical life (typical)	AC1	ABS VO, light grey	
Level probe supply		Screw type	
Max. 5 VAC		M3	
Level probe current		Tightening torque min/max	
Max. 2 mA		0.4Nm/0.8Nm	
Sensitivity		Weight	
5 K Ω to 150 K Ω , C _F * = 2.2 nF		AC/DC supply	
Factory preset 150 K Ω		125 g	
Dielectric voltage		Approvals	
>2.0 KVAC (rms) (contacts / electronics)		UL	
		CSA	
		cURus	
		UL508, UL325, CSA-C22.2 No.247	
		CE marking	
		Yes	

*C_F = maximum Cable Capacitance



Mode of Operation

Connection cable
2 conductor PVC cable, normally screened. Cable length: max. 100 m. The resistance between the cores and the ground must be at least 150K. Normally, it is recommended to use a screened cable between probe and controller, e.g. where the cable is placed in parallel to the load cables (mains). The screen has to be connected to Y2 (reference).

The filling or emptying process operate around one single electrode and a time control circuit.

Cautions

Overrunning of tank filling
Cautions must be taken to assure that the tank cannot


overrun. Factors that have to be considered are the pump performance, the rate of discharge from the tank, the position of the single level electrode and the time delay.

Prevent dry running of pump on emptying

Care must be taken to ensure that the pump cannot run dry. Similar considerations must be given as mentioned above. Specifically keeping the time delay to a minimum will minimize this risk, but again, it will increase the switching rate.


Example 1
The diagram shows the level control connected as filling or emptying control. The relay react to the low alternating current created when the electrodes are in contact with the liquid.

The reference (Ref) must be connected to the container or if the container consists of a non-conductive material, to an additional electrode. (To be connected to pin Y2). (In the diagram this electrode is shown by the dotted line).

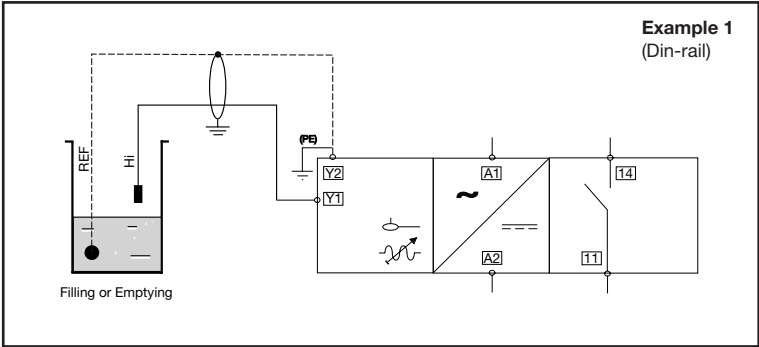


Operation Diagram


Filling with ON-delay (prevent overflow) (Hi-probe)

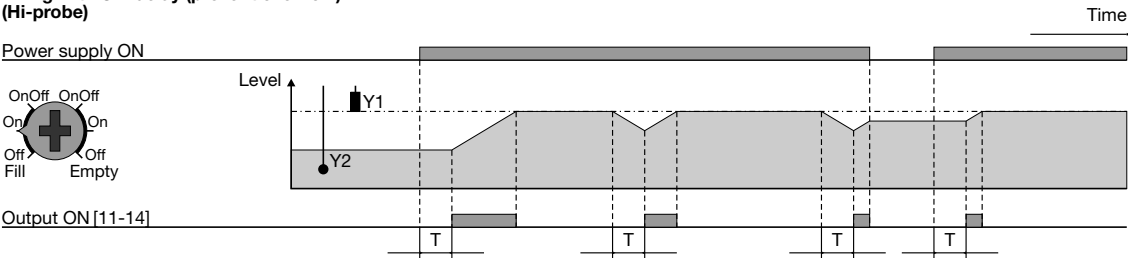

Filling with Off-delay (Lo-probe)

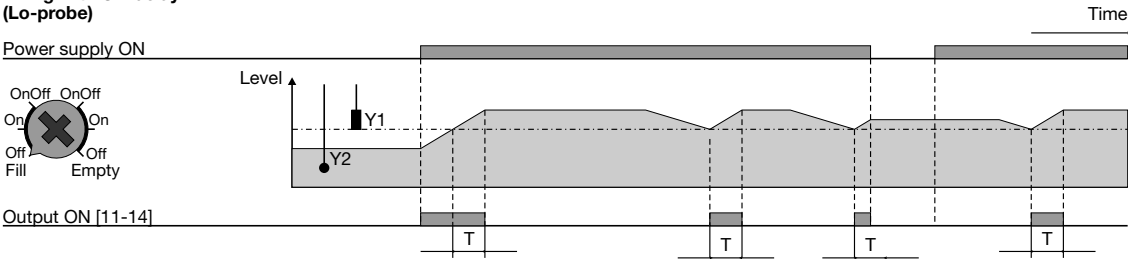


Filling with ON and Off-delay (Center-probe)

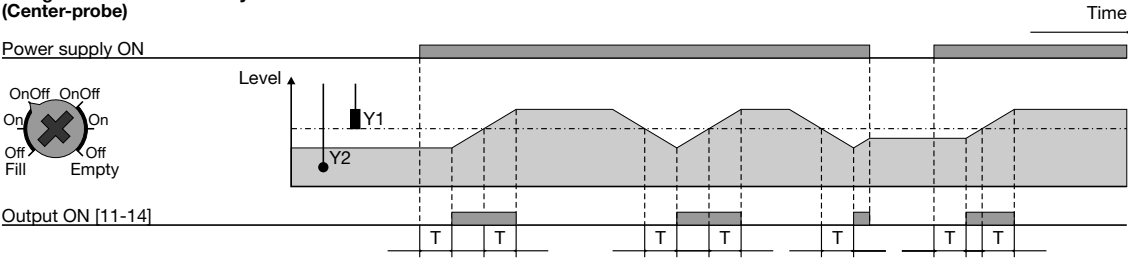


Operation Diagram


Emptying with Off-delay (Hi-probe)

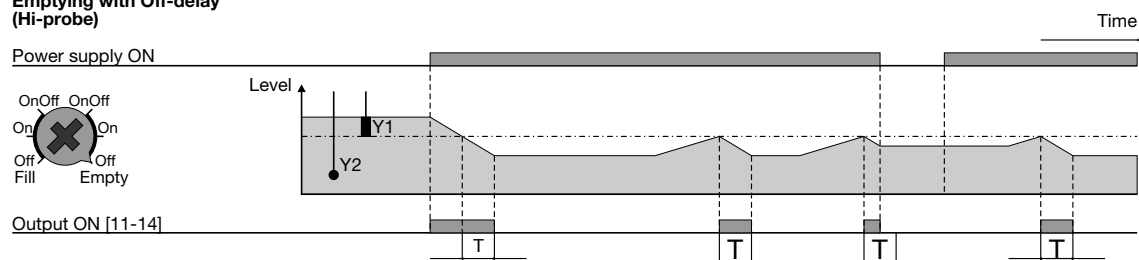

Emptying with ON-delay (Prevent dry run) (Lo-probe)

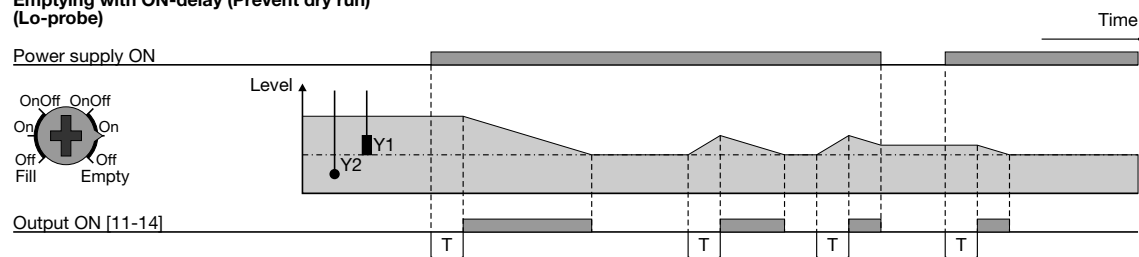


Emptying with ON and Off-delay (Center-probe)

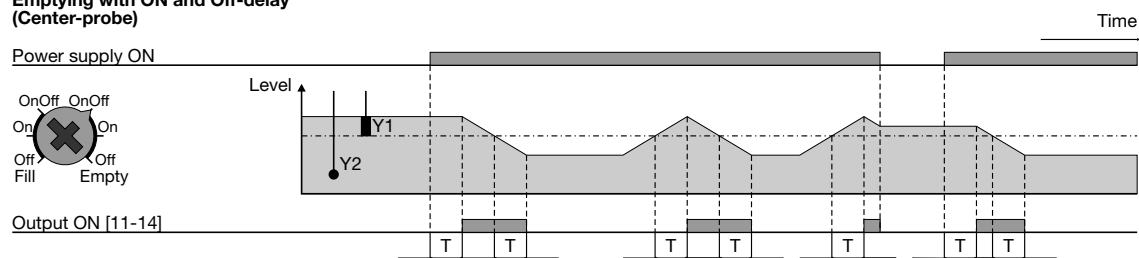




Wiring Diagram

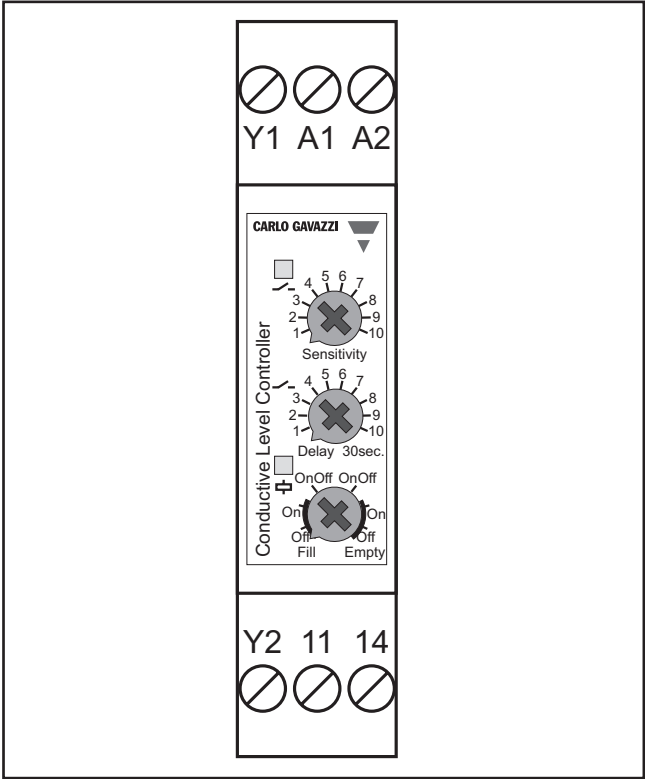

Dimension Drawings

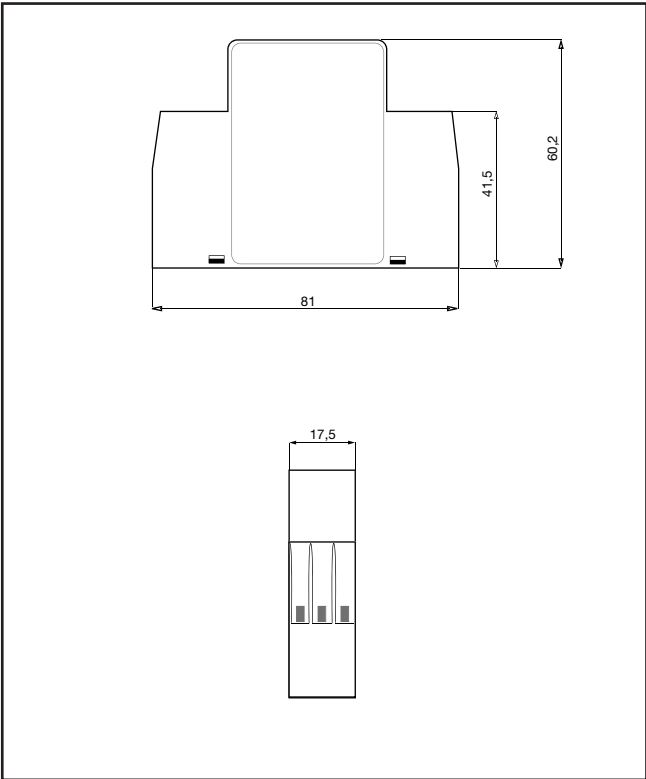

Delivery Contents

- Amplifier
- Packaging: Carton box
- Manual