



Chipsmall Limited consists of a professional team with an average of over 10 year of expertise in the distribution of electronic components. Based in Hongkong, we have already established firm and mutual-benefit business relationships with customers from,Europe,America and south Asia,supplying obsolete and hard-to-find components to meet their specific needs.

With the principle of "Quality Parts,Customers Priority,Honest Operation,and Considerate Service",our business mainly focus on the distribution of electronic components. Line cards we deal with include Microchip,ALPS,ROHM,Xilinx,Pulse,ON,Everlight and Freescale. Main products comprise IC,Modules,Potentiometer,IC Socket,Relay,Connector.Our parts cover such applications as commercial,industrial, and automotives areas.

We are looking forward to setting up business relationship with you and hope to provide you with the best service and solution. Let us make a better world for our industry!



Contact us

Tel: +86-755-8981 8866 Fax: +86-755-8427 6832

Email & Skype: info@chipsmall.com Web: www.chipsmall.com

Address: A1208, Overseas Decoration Building, #122 Zhenhua RD., Futian, Shenzhen, China



Uninterruptible Power Supply (UPS) Integrated battery type S8BA-LF

DC-DC type small UPS mounts on a DIN rail to provide an ideal countermeasure for momentary power losses and power failures in industrial computers (IPC) and controllers.



- System reliability greatly improved because 24VDC power supply is backed up for a certain period of time in the event of voltage drop or power failure.
- Compactness, weight reduction, and long battery life realized thanks to the adoption of a lithium-ion battery.
- Push-in terminal block adopted for the power input and output I/F.
- Shutdown in conjunction with the industrial purpose computer (IPC) or controller realized by the USB/RS-232C/I/O port installed in the UPS.

⚠ Refer to Safety Precautions on page 13.

Model Number Structure

Model Number Legend * Use the following format to place an order.

S8BA- □ □ □ □ □ □ □ □ **LF**
Series name 1 2 3

- | | |
|---------------------------------------|--------------------|
| 1. Input voltage specification | 3. Capacity |
| 24D: 24 VDC | 120: 120 W |
| | 240: 240 W |
| 2. Output voltage | 360: 360 W |
| 24D: 24 VDC | 480: 480 W |

Ordering Information

Main body
Uninterruptible Power Supply (UPS)

| Input voltage | Output voltage | Output current/capacity | Model number |
|---------------|----------------|-------------------------|------------------|
| 24 VDC | 24 VDC | 5 A/120 W | S8BA-24D24D120LF |
| | | 10 A/240 W | S8BA-24D24D240LF |
| | | 15 A/360 W | S8BA-24D24D360LF |
| | | 20 A/480 W * | S8BA-24D24D480LF |

* 16.7 A/400 W for use as a UL compliant device.

Communication cable

| Specifications | Type | Length | Model number |
|------------------|--------------------|--------|--------------|
| For RS-232C port | RJ45/Dsub9PIn | 2 m | S8BW-C01 |
| For CONTACT port | RJ45/Discrete wire | | S8BW-C02 |

Replacement battery pack

| Rated voltage | Rated capacity | Weight | Model | UPS Model : Required units |
|---------------|----------------|--------|------------|--|
| 14.4 VDC | 1600 mAh | 0.3 kg | S8BA-B120L | S8BA-24D24D120LF : 1 pcs S8BA-24D24D240LF : 2 pcs S8BA-24D24D360LF : 3 pcs S8BA-24D24D480LF : 4 pcs |

S8BA-LF

Ratings, Characteristics, and Functions

| Item | Capacity | 120 W | 240 W | 360 W | 480 W *4 | |
|--|--|--|---|-----------------------|-----------------------|-----------------------|
| DC input | Rated input voltage | | 24 VDC | | | |
| | Input voltage range | When standard voltage sensitivity is set | 24 VDC±10% | | | |
| | | When low voltage sensitivity is set | 24 VDC±12.5% | | | |
| | | When high voltage sensitivity is set | 24 VDC±5% | | | |
| | Input maximum current | for rated input voltage for rated loads connected | 5.9 A | 11.7 A | 17.5 A | 23.3 A *5 |
| | Input terminal | | Push-in terminal block | | | |
| | Input protection | | Fuse (cannot be replaced by the customer) | | | |
| Input protection capacity | | 10 A | 15 A | 30 A | | |
| DC output | Rated current | (for rated output voltage) | 5 A | 10 A | 15 A | 20 A *6 |
| | Switching time | | Uninterrupted | | | |
| | Output voltage | Normal operation | Output of input voltage as-is | | | |
| | | Backup operation | 24 V±5% | | | |
| | Output terminal | | Push-in terminal block | | | |
| | Overload protection | | Alarm display at a load level of 110% or over (normal operation) | | | |
| Alarm display at a load level of 110% or over and output voltage drop (backup operation) | | | | | | |
| Alarm display cancellation at a load equal to or below the rated capacity (normal operation, backup operation) | | | | | | |
| Battery | Type | | Lithium-ion battery | | | |
| | Rated voltage | | 14.4 VDC | | | |
| | Rated capacity | | 1600 mAh × 1 parallel | 1600 mAh × 2 parallel | 1600 mAh × 3 parallel | 1600 mAh × 4 parallel |
| | Expected battery life *1 | | 2.5 years (50°C), 5 years (40°C), 10 years (25°C) | | | |
| | Replacement by user | | Yes (Hot swapping) | | | |
| | Auto battery check function | | Yes | | | |
| | Battery life counter function | | Yes | | | |
| | Charging time | | 4 hours *7 | | | |
| Backup time (25°C, initial characteristics) | | 6 min. (120 W) | 6 min. (240 W) | 6 min. (360 W) | 6 min. (480 W) | |
| Environment | Operating ambient temperature/humidity | | 0 to +55°C/10 to 90% (with no condensation) | | | |
| | Storage ambient temperature/humidity | | -20°to +55°C/10 to 90% (with no condensation) | | | |
| | Vibration resistance | | JIS C 60068-2-6 compliant. 5 to 8.4 Hz amplitude: 3.5 mm, 8.4 to 150 Hz acceleration rate: 9.8 m/s ² X, Y, and Z directions for 100 minutes (Time coefficient: 10 minutes × coefficient factor 10 = total time 100 min.) | | | |
| | Shock resistance | | JIS C 60068-2-27 compliant. 147 m/s ² , 3 times in X, Y, and Z directions. | | | |
| Structure | Dimensions (W × D × H mm) | | 94 × 100 × 100 | 148 × 100 × 100 | 270 × 100 × 100 | |
| | Weight of unit | | Approx. 0.8 kg | Approx. 1.3 kg | Approx. 2.0 kg | Approx. 2.3 kg |
| | Cooling method | | Natural cooling | | | |
| Insulation and withstand voltage | Withstand voltage | | 1,000 V 50/60 Hz AC between the DC external terminals and the GR terminal for 1 minute at a leakage current of 10 mA max. | | | |
| | Insulation resistance | | 20 MΩ min. between the DC external terminals and the GR terminal (at 500 VDC) | | | |
| Compliance to standard | Safety standard | | UL508/CE/C22.2 No.107.1-01 / EAC | | | |
| | EMI | Radiated disturbance electromagnetic field strength | EN61000-6-4/FCC/ICES/RCM/KC | | | |
| | Ship standard | | LR/ABS/EN60945 *8/DNV GL | | | |
| Internal power consumption (normal *2 / maximum *3) | | 7 W/22 W | 11 W/41 W | 14 W/60 W | 18 W/80 W | |
| Serial communication | RS-232C (Interface terminal) | | Yes (RJ45) | | | |
| | USB (interface terminal) | | Yes (B connector) | | | |
| I/O signal (Interface terminal) | | Yes (RJ45) | | | | |
| Accessories | | USB cable (1.5 m) | | | | |
| Accessory functions | | Beeper setting; Auto restart setting; Auto test setting; Auto restart mode setting; Input sensitivity setting; Remote ON/OFF signal logic setting; Cold start setting; Battery life counter setting; Power switch function setting; Maximum backup time setting; Startup battery level setting; Backup stop (BS) signal delay time setting; Backup (BU) signal delay time setting; and Contact signal I/O test | | | | |

*1. An estimated value for standard mounting. Not a guaranteed value.

*2. Conditions: With rated loads connected, at a rated input voltage, and with the battery fully charged.

*3. Conditions: With rated loads connected, at a rated input voltage, and at the maximum battery charging current.

*4. 400 W for use as a UL compliant device.

*5. 20 A for use as a UL compliant device.

*6. 16.7 A for use as a UL compliant device.

*7. When using in an environment at a high temperature, charging may be paused by charging temperature protection, then the charging time will be longer than specified time.

"CS" will be displayed when charging temperature protection is operated.

*8. For the S8BA-24D24D120LF, install all of the RSMN-2030, RSHN-2030, and RSEN-2030 EMC filters manufactured by TDK. For the S8BA-24D24D240LF, S8BA-24D24D360LF, or S8BA-24D24D480LF, install both the RSMN-2030 and RSHN-2030 or their equivalents. Install these filters in series to the cable connected to the DC input terminal block.


When you do, do not connect anything to the GR terminal.

The effectiveness of the noise filters may be affected by the installation environment. Be sure to check effectiveness before starting operation.


Nomenclature

Front view


S8BA-24D24D120LF (120 W)

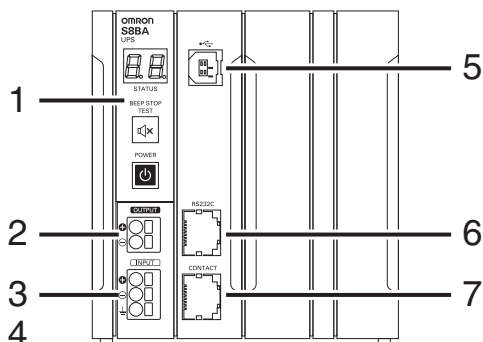

Enlarged view of the operation panel

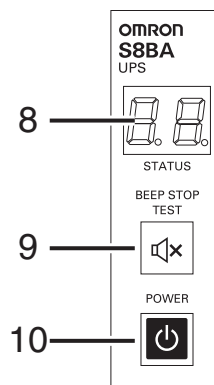


S8BA-24D24D240LF (240 W)

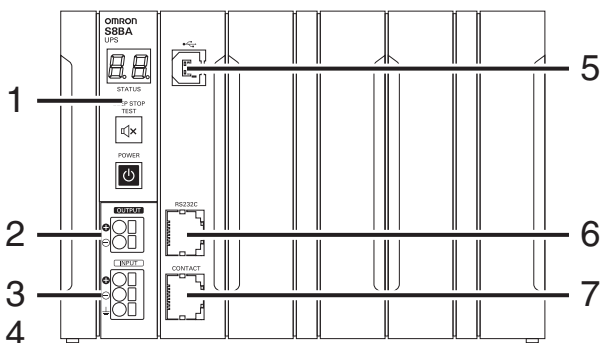

S8BA-24D24D360LF (360 W)

S8BA-24D24D480LF (480 W)

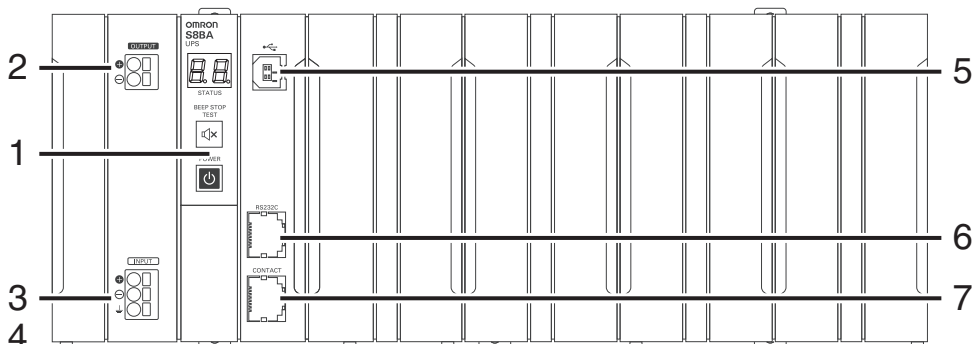


| No. | Name | Function |
|-----|--------------------------------------|---|
| 1 | Operation panel | Describe the name of each part. |
| 2 | DC output terminal block | Connect to load lines. (+V), (-V) |
| 3 | DC input terminal block | Connect to input lines. (+V), (-V) |
| 4 | GR terminal \perp | Ground this terminal to less than 100 Ω to improve noise resistance and prevent electrical shock. |
| 5 | USB port | Connect to a USB cable. |
| 6 | RS-232C port | Connect to a RS-232C cable. |
| 7 | CONTACT port | I/O port. Connect to a signal line. |
| 8 | “Status indicator” digital indicator | The seven-segment display indicates the status of the UPS. |
| 9 | “Beep Stop/Test” switch | Stop the beeper and perform self-diagnosis testing. |
| 10 | “Power” switch | Turn the power of the UPS ON/OFF. |


S8BA-LF

Rear view

S8BA-24D24D120LF (120 W)

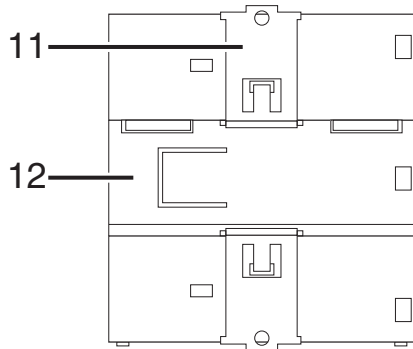


S8BA-24D24D240LF (240 W)

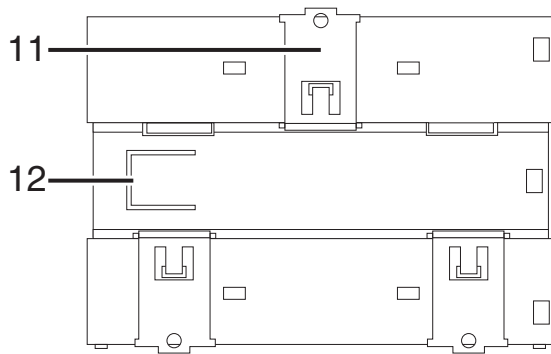

S8BA-24D24D360LF (360 W)

S8BA-24D24D480LF (480 W)

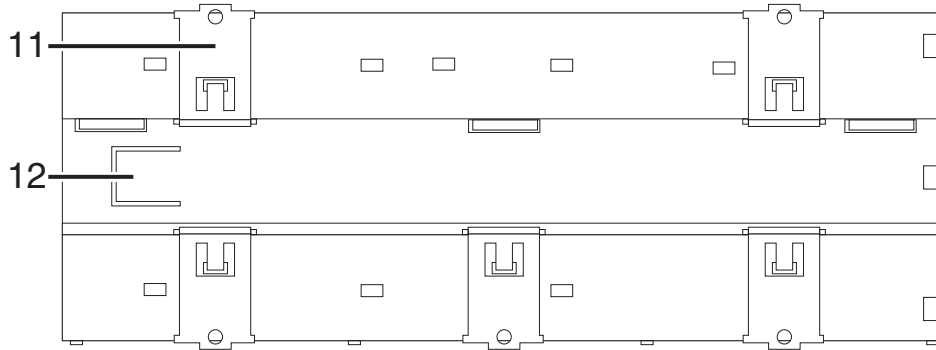


| No. | Name | Function |
|-----|--------------------------|--|
| 11 | DIN rail mounting hook | Hook the UPS on the DIN rail. |
| 12 | DIN rail mounting groove | Groove for positioning the DIN rail and the UPS. |

Connections

Block Diagrams


S8BA-24D24D□□□LF

Diagram of the Input/output circuit block

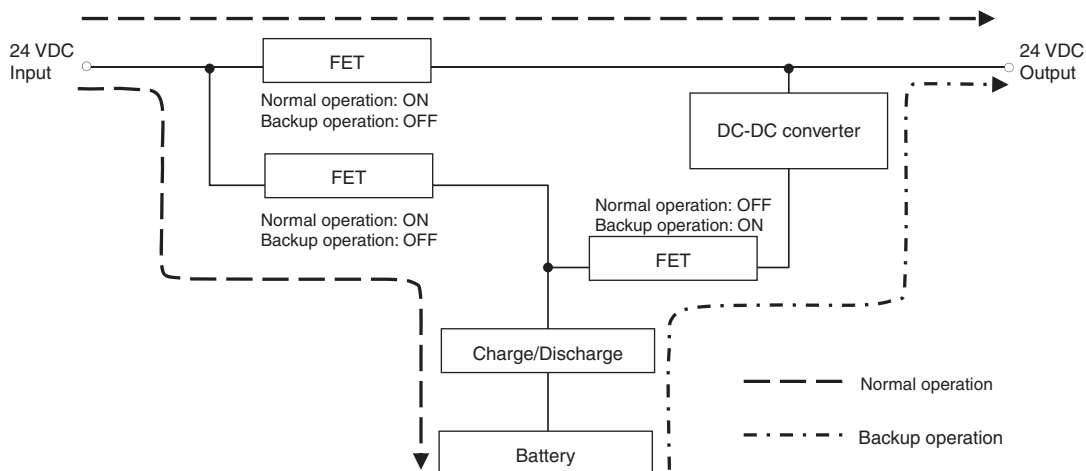

* In normal operation, 24 VDC is output as-is for charging the battery and from the input power supply. If 24 VDC from the input power supply drops, the operation automatically switches to backup operation, and 24 VDC is output from the battery.

Input and output voltage time chart when shifting to backup operation

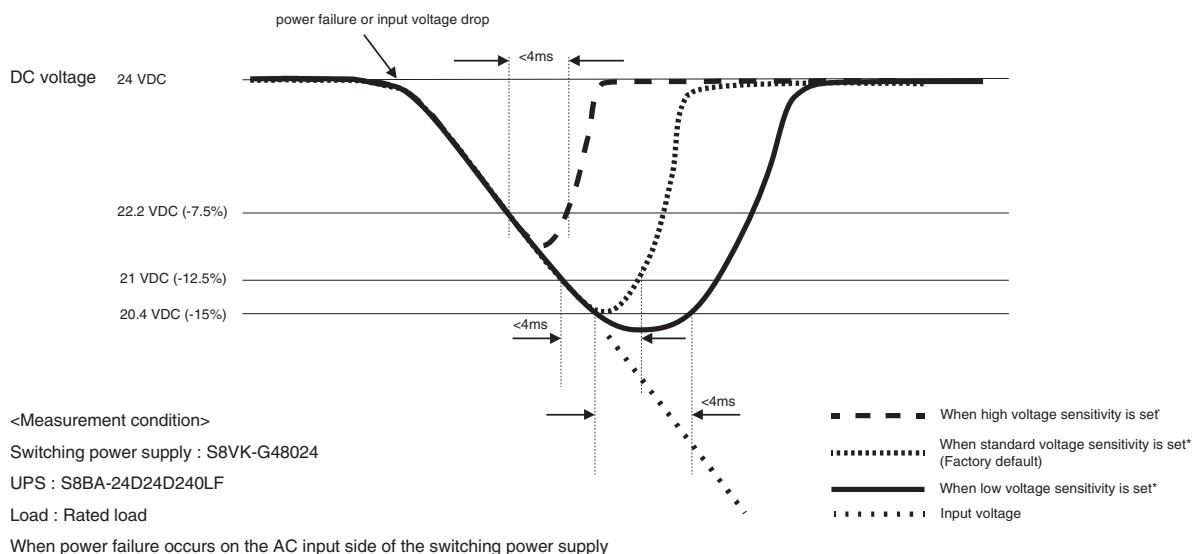

Connecting a cable to Battery connection terminal block, the input terminal block and the output terminal block

For details about the connectable sizes and recommended cable sizes, see the following table.

| Connectable size | Cable | Solid wire | 0.2 to 4.0 mm ² |
|--|-------------------------|-------------------------|----------------------------|
| | | Twisted pair | 0.2 to 2.5 mm ² |
| | | AWG | AWG24 to 12 |
| Stripped cable length | | 8 to 10 mm | |
| Recommended cable size | 5 A | Solid wire/Twisted pair | 0.5 mm ² |
| | | AWG | AWG20 |
| | 10 A | Solid wire/Twisted pair | 0.75 mm ² |
| | | AWG | AWG16 |
| | 15 A | Solid wire/Twisted pair | 1.25 mm ² |
| | | AWG | AWG14 |
| 20 A | Solid wire/Twisted pair | 2.0 mm ² | |
| | AWG | AWG12 | |
| Temperature rating for recommended cable | | 90°C | |

I/O signal functions

Type of output signals

| Signal | Description |
|--|---|
| Backup signal output (BU) | Stays ON during backup operation at a power failure. |
| Low battery level signal output (BL) | Goes ON when the battery becomes weak during backup operation at a power failure. |
| Trouble signal output (TR) | Goes ON when an internal failure of the UPS occurs or when the battery life counter expires. |
| Battery replacement signal output (WB) | Goes ON when the test determines that battery replacement is necessary due to deterioration or when the battery life counter reaches the replacement period. (The life counter operates while input power is being supplied.) |


Type of input signals

| Signal | Description |
|-----------------------------------|---|
| Input of the UPS stop signal (BS) | When the BS signal is ON (High), the output of the UPS is stopped after the time period specified in advance has elapsed. * |
| Remote ON/OFF signal | Remote ON/OFF signals can be used to start and stop the UPS, by using either an externally connected contact or the ON/OFF status of the open collector circuit. When signal is OFF, the UPS will be turned on. When signal is ON, the UPS will be turned off. In the factory settings, the UPS stops operation when this is short-circuited. In addition, it is necessary to turn on the "Power" switch of UPS to use this function. |

* BS signal delay time

It is possible to set the period of time from when a BS signal is received until the output of the UPS is stopped. The output of the UPS can be stopped by inputting the voltage signal (High).


I/O signal port (RJ45 connector)

| Outlook of the connector | Pin number | Item |
|--|------------|--|
|  | 1 | Backup signal output (BU) |
| | 2 | Remote ON/OFF input (-) |
| | 3 | Trouble signal output (TR) |
| | 4 | COMMON (COM) |
| | 5 | Battery LOW signal output (BL) |
| | 6 | Backup stop signal input (BS) |
| | 7 | Battery Replacement Signal output (WB) |
| | 8 | Remote ON/OFF input (+) |

Contact signal ratings

| Signal | Description |
|--------------------------------|---|
| Signal output (BL, TR, BU, WB) | <ul style="list-style-type: none"> Applicable voltage: 50 VDC or less Maximum current: 360 mA BU signal min. response time: 10 ms |
| Remote ON/OFF | <ul style="list-style-type: none"> Voltage between terminals: 5 VDC Current when closed: 10 mA max. Min. signal response time: When stopped 100 ms When restarting 300 ms |
| UPS Stop Signal input (BS) | <ul style="list-style-type: none"> Input voltage: HIGH (ON) 8 to 24 VDC LOW (OFF) 0.5 VDC or less Input current: 1.7 to 5.1 mA Min. signal response time: When stopped 100 ms When restarting 300 ms |

Contact signal circuit

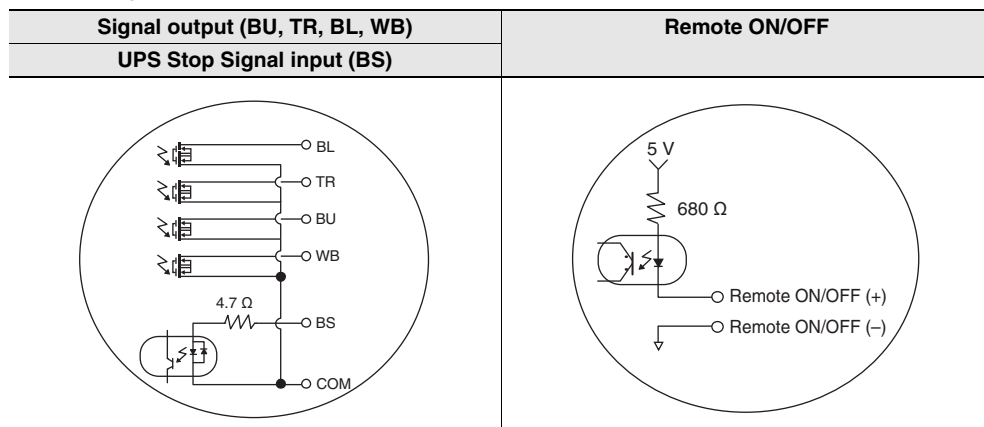

Precautions when selecting switch mode power supplies

When selecting switch mode power supplies, install devices with a capacity larger than the total of the UPS internal power consumption and internal power consumption of connected devices to the input side of the UPS. When these conditions are met, usage will be possible with no problems even if the rated capacity of the UPS is larger than the rated capacity of the switching power supply.

Switch mode power supply capacity > (UPS internal power consumption + Internal power consumption of connected devices)

(Ex.)

$$\text{Switch mode power supply (Capacity: 92 W or more)} > \left(\begin{array}{l} \text{UPS} \\ \text{(Internal power consumption: 22 W)} \end{array} + \begin{array}{l} \text{Industrial-purpose computers (IPC)/controllers, etc.} \\ \text{(Internal power consumption: 70 W, DC input)} \end{array} \right)$$



S8BA
(Capacity: 120 W)

S8BA-LF

Engineering Data

Estimated backup time

The backup time varies depending on the capacity of connected devices.

After calculating the total capacity of connected devices, refer to the graph of the backup time to obtain an estimation of the initial value of the backup time. (This is also applied to checking the battery.)

1. Convert the total capacity (power consumption) of the connected devices to watts (W).

For the indication of connected devices, check your computer and the rear of the display.

The indicator can show values in two different ways: amperes (A), and watts (W).

Example 1: 24 VDC, 145 W

Example 2: 24 VDC, 1.8 A

| Indication | Value |
|------------|-------------------|
| A | $W = A \times 24$ |


For devices that use the A indication, convert the capacity into W.

Example 2: 1.8 (A) = 1.8×24 (W) = 43.2 (W)

2. Add the values converted into W to obtain the total capacity of the connected devices.

3. Calculate the initial value of the backup time for the total capacity of the connected devices from the graph below.

- Graph of backup time (graph of initial values for products that have not been used at 25°C). The backup time becomes shorter than the graph (table) below when temperature is lower.

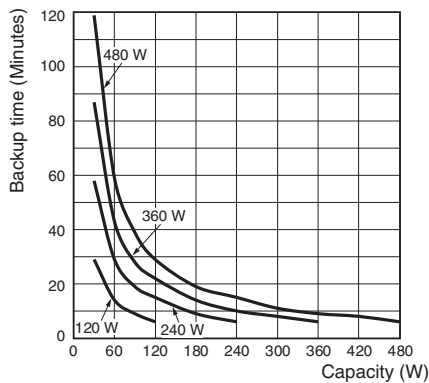

- The smaller the capacity of connected devices becomes, the longer the backup time becomes.

Backup time table


(Time unit: minutes)

| | Capacity (W) | | | | | | | | | |
|--------------------------|--------------|----|----|-----|-----|-----|-----|-----|-----|-----|
| | 30 | 60 | 90 | 120 | 180 | 240 | 300 | 360 | 420 | 480 |
| S8BA-24D24D120LF (120 W) | 29 | 14 | 9 | 6 | — | — | — | — | — | — |
| S8BA-24D24D240LF (240 W) | 58 | 29 | 19 | 15 | 9 | 6 | — | — | — | — |
| S8BA-24D24D360LF (360 W) | 87 | 43 | 28 | 22 | 14 | 10 | 8 | 6 | — | — |
| S8BA-24D24D480LF (480 W) | 119 | 59 | 39 | 29 | 19 | 15 | 11 | 9 | 8 | 6 |

Note: The above backup times are for reference only. They may change depending on the battery life and external environment (such as temperature).


Derating curve

120, 240 W
 <S8BA-24D24D120LF>
 <S8BA-24D24D240LF>

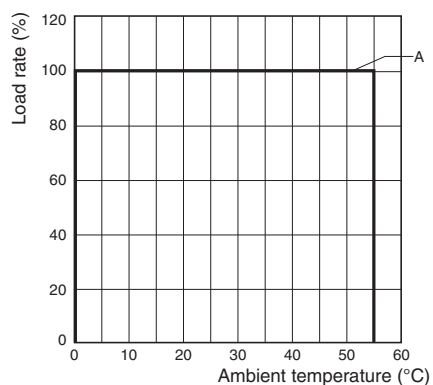


A: For standard mounting, face-up mounting, stationary mounting

360 W
 <S8BA-24D24D360LF>

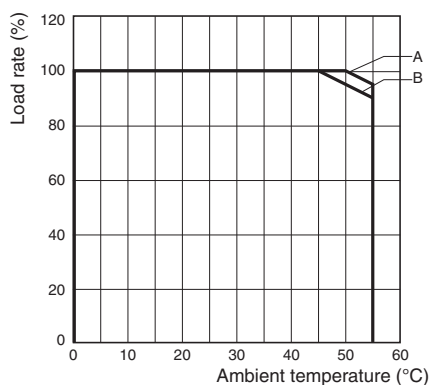


A: For standard mounting,
 B: For face-up mounting, stationary mounting

480 W
 <S8BA-24D24D480LF>

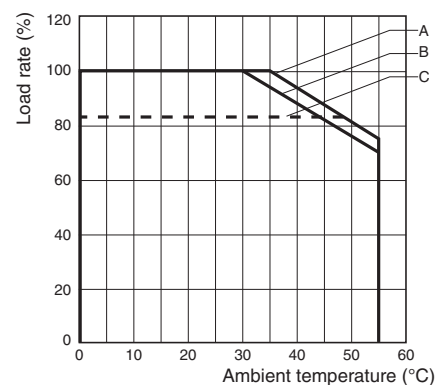


A: For standard mounting,
 B: For face-up mounting, stationary mounting
 C: For standard mounting (For use as a UL compliant device)

Backup operation sequence in the event of power failure/voltage drop (instantaneous voltage drop)
 When the input power supply recovers while the battery level is sufficiently high

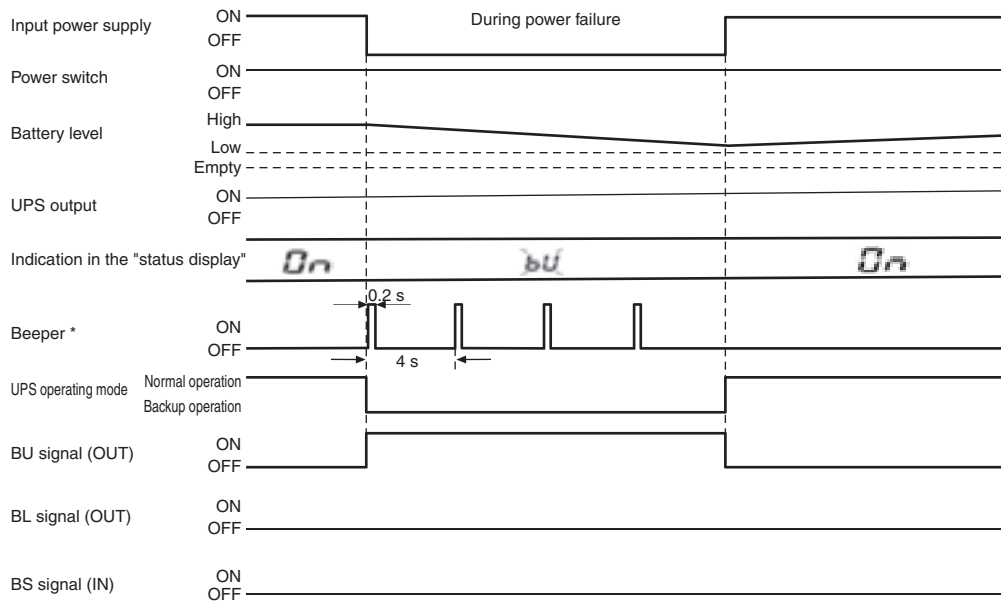


* "Disable beeper" is set by factory default. Even when "Disable beeper" is set, the buzzer sounds at startup.

When the input power supply recovers while the battery level is Low

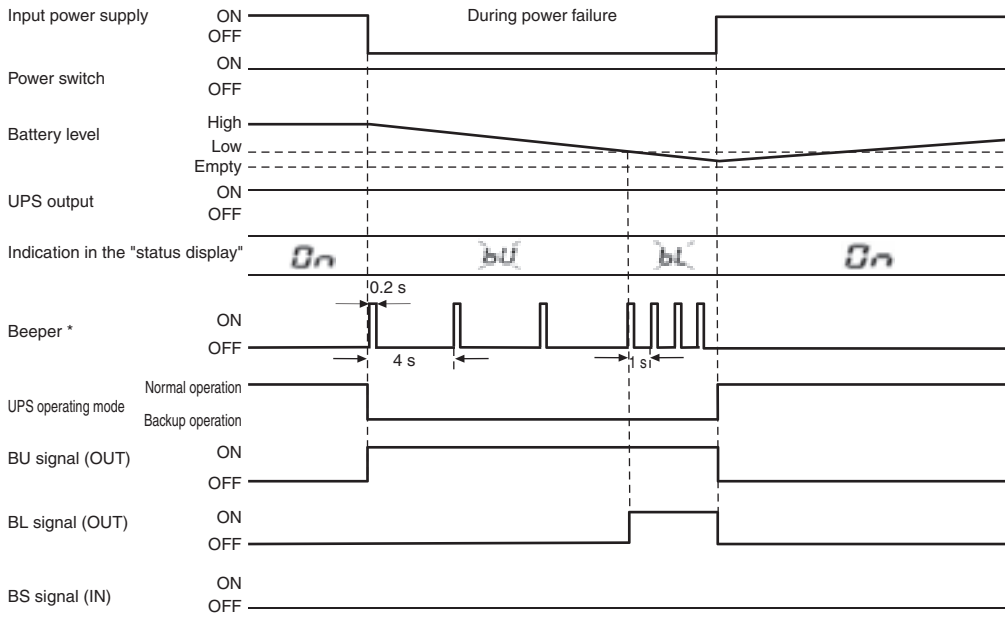

* "Disable beeper" is set by factory default. Even when "Disable beeper" is set, the buzzer sounds at startup.


When the input power supply does not recover until the battery becomes empty

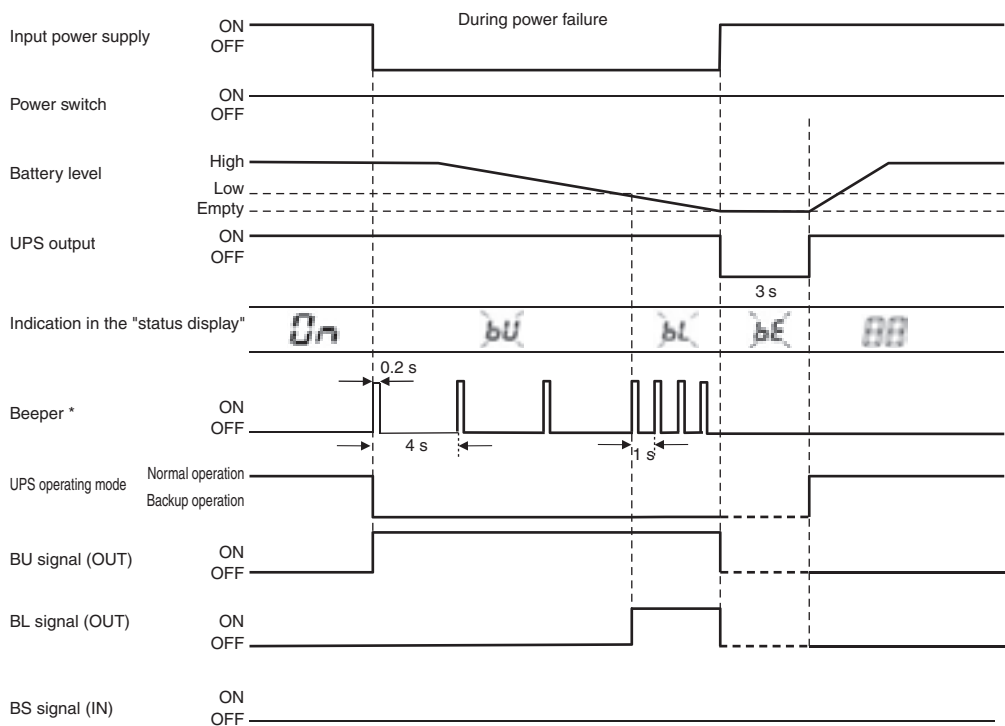

* "Disable beeper" is set by factory default. Even when "Disable beeper" is set, the buzzer sounds at startup.

Overcurrent protection curve

120W, 240W, 360W, 480W

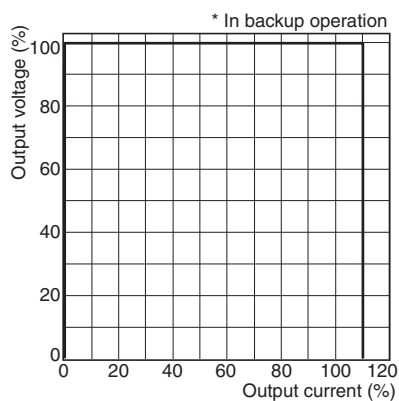


Note: 1. In backup operation, the output voltage drops at a load rate of 110% or higher.
 2. In normal operation, the output stops when the input protection fuse blows out.

Dimensions


(Unit: mm)

Main body

S8BA-24D24D120LF (120 W)

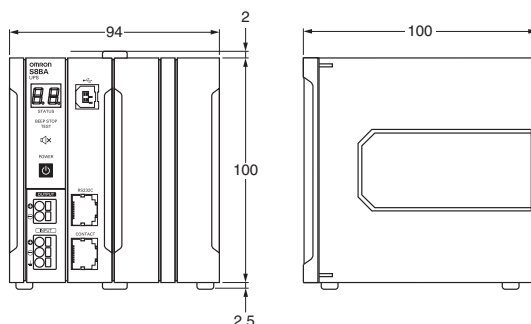


S8BA-24D24D240LF (240 W)

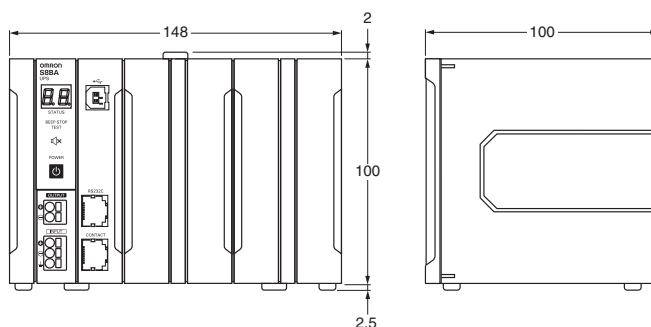

S8BA-24D24D360LF (360 W)



S8BA-24D24D480LF (480 W)

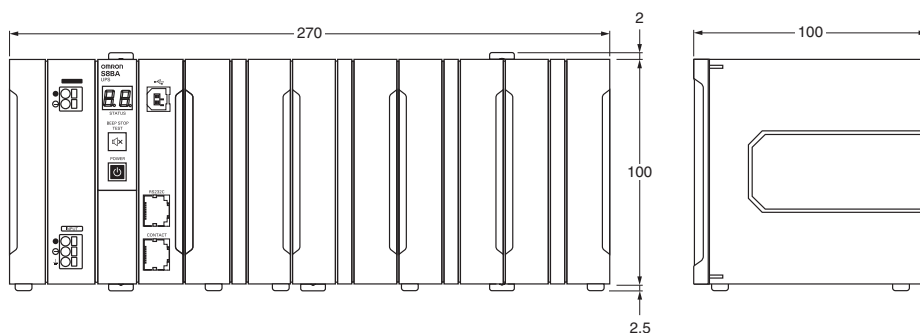

DIN Rail (Order Separately)



Mounting Rail (Material: Aluminum)

PFP-100N
PFP-50N

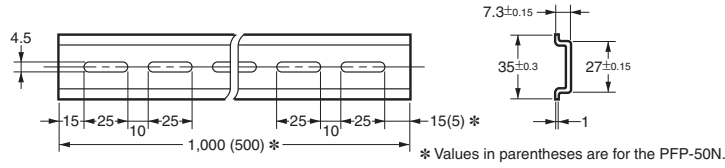



Mounting Rail (Material: Aluminum)

PFP-100N2

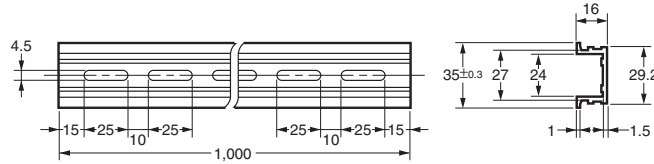

End Plate

PFP-M

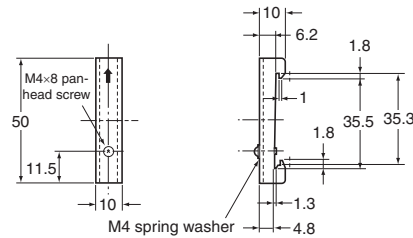

- Note:**
1. If there is a possibility that the Unit will be subject to vibration or shock, use a steel DIN Rail. Otherwise, metallic filings may result from aluminum abrasion.
 2. If the Unit may be subjected to sliding to either side, attach an End Plate (model PFP-M) on each side of the Unit.



Power management solutions

The following software is available as a free download from our website.







| Name | Description | Conditions | Interface |
|--------------------------|--|---|---------------|
| Power Attendant Lite | <ul style="list-style-type: none"> You can execute computer shutdown and UPS auto stop when an input power problem occurs (power failure, etc.). You can use a computer that has "Power Attendant Lite" installed to send a script over the network to devices that do not have shutdown software installed to log in to each device and execute a device shutdown command. You can automatically start and stop computers and the UPS according to a preset schedule. | Windows 10 / 8.1 / 8 / 7 Windows Server 2016 Windows Server 2012 R2 / 201208 Windows Storage Server 2008 Windows Storage Server 2016 Windows Storage Server 2012 R2 / 2012 Windows Storage Server 2008 R2 / 2008 | RS232C USB |
| Simple Shutdown Software | <ul style="list-style-type: none"> You can execute computer shutdown and UPS auto stop when an input power problem occurs (power failure, etc.). You can modify and recompile the source code to incorporate a UPS management function into your Windows/Linux® system. Supports Windows and Linux | <For Windows> Windows 10 / 8.1 / 8 / 7 Windows Server 2012 R2 / 2012 Windows Server 2008 R2 / 2008 Windows Server 2003R2 / 2003 Windows Vista / XP Windows 10 IoT Enterprise LTSC Windows Embedded Standard 7 <For Linux> Red Hat Enterprise Linux Ver.7.x CentOS Ver.7.x | RS232C USB |
| Setting Utility | This software is used to configure UPS settings. (Setting item examples) Function for sending commands Function for saving settings to a backup file Function for restoring settings from a backup file Function for reading UPS settings Function for returning UPS settings to default settings | Windows 10 / 8.1 / 8 / 7 Windows Server 2012 R2 / 2012 Windows Server 2008 R2 / 2008 Windows Server 2003R2 / 2003 Windows Vista / XP Windows 10 IoT Enterprise LTSC Windows Embedded Standard 7 | RS232C USB |

Safety Precautions

Warning Indications

| | |
|--|---|
|  Warning | Indicates a potentially hazardous situation that, if not avoided, could result in serious injury or death. Additionally there may be significant property damage. |
|  Caution | Indicates a potentially hazardous situation that, if not avoided, could result in minor or moderate injury or property damage. |
| Precautions for Safe Use | Supplementary comments on what to do or avoid doing to use the product safely. |
| Precautions for Correct Use | Supplementary comments on what to do or avoid doing to prevent failure to operate, malfunction, or undesirable effects on product performance. |

Meaning of Product Safety Symbols

| | |
|---|--|
|  | General inhibition Notice prohibiting an unspecified general action. |
|  | General instruction Notice instructing an unspecified general action. |
|  | Do-not-disassemble prohibition Notice prohibiting disassembly because disassembling the device may cause such an accident as an electric shock. |
|  | Prohibition of use in locations subject to water such as a bathroom and shower room Notice prohibiting installation of the device in locations subject to water, because if a device not made water-proof is used in such locations, injury may occur due to an electric leak. |
|  | Do-not-touch prohibition Indicates the possibility of injuries by touching the specific portion of the device under specific conditions, prohibiting touching of the device. |
|  | Explosion alert Notice alerting the user to the possibility of explosion under certain conditions. |

WARNING

(for use of this product)

- Provide safety measures in external circuits, not in the UPS, in order to ensure safety in the system if an abnormality occurs due to malfunction of the UPS or another external factor affecting the UPS operation. Not doing so may result in serious accidents.



(When replacing the battery unit)

Dispose of or collect (recycle) the battery unit according to your own rules set for that purpose or as instructed by laws and regulations.

- Do not dispose of it in fire. Otherwise, it could explode.



廢電池請回收

Caution

(for installation and connection)

Carry the unit considering its weight and balance, and place it on a stable and robust base.

- If you drop the unit, the battery or the battery protection mechanism may be broken, and it may result eventually in a fluid leak, abnormal heating, smoke, rupture or fire.
- If you drop the unit, stop using it and have it inspected and repaired.
For details on repair, contact the OMRON representative.



Keep plastic package bags out of reach of children.

- Children may suffocate if they place their heads into plastic bags.



Make sure to connect the “input power supply” to the direct power supply equipment with a rated voltage (24 VDC).

- The input voltage ranges for the UPS are as shown below. Check that the output voltage of the direct power supply equipment connected to the input terminal of the UPS is within any of the voltage ranges below.
 - 24 VDC±10% (Input voltage range: When standard voltage sensitivity is set)
 - 24 VDC±12.5% (Input voltage range: When low voltage sensitivity is set)
 - 24 VDC±5% (Input voltage range: When high voltage sensitivity is set)
- Connecting to a DC or AC power supply device with a different voltage may result in malfunction in or damage to the UPS, or cause a fire.



When an abnormality (unusual sound or smell) occurs, turn OFF the unit’s “Power” switch to stop the output, and stop the supply of commercial power.

- When performing maintenance on the connected devices, follow the above instructions to ensure safety.



When installing the input cable, make sure to perform the connection as specified.

Make sure to stop the primary power supply before connecting the unit to the input power supply terminal.

- When connecting a cable to the terminal block, use a cable that complies with the input current specification of the UPS. Failure to do so may result in electric shock or ground fault.



Do not disassemble, repair, or modify the unit.

- Doing so may cause an electric shock or a fire.



Do not install the unit in other than specified orientations.

- Dropping or toppling the unit may cause injury.
- If the UPS is not installed in the specified direction, the internal temperature may rise, eventually damaging the UPS or deteriorating the battery.



Do not use the unit where the maximum temperature exceeds 55°C.

- The battery deteriorates rapidly. It may result in fire.
- If the battery’s resin separator is damaged, the battery may be short-circuited inside, and may cause an abnormal heating, smoke, rupture or fire.
- Doing so may cause a failure or malfunction of the unit.



Do not exceed the ranges specified for environmental conditions during use/storage.
 Do not install or store the unit in the places listed below.

- Do not store in places where the humidity is lower than 10% or higher than 90%.
- Do not use the unit in places where the ambient temperature is lower than 0°C or higher than 55°C. (With no condensation)
- Do not use in places where the humidity is lower than 10% or higher than 90%.
- Do not install/store the unit in closed places such as cabinets with no clearance, places where there is flammable or corrosive gas,
- Places with large amounts of dust, places exposed to direct sunlight, places exposed to shock or vibration, salty or wet places, or outdoors.
- Installation or storing the unit in such a place may cause a fire.



When you use plug strip and other plugs to connect additional devices, do not connect devices that exceed the current capacity of the available plugs.

- The current protection of the unit may operate, which may stop the output.
- The cable heats up, which may cause a fire.



Do not pinch or sharply bend the cable.
 Do not fold or knot the cable.

- Doing so may cause the cable to be damaged or heated, which may cause an electric shock or a fire.
- If the cable is damaged, stop using the unit and have the cable repaired.
- For details on repair, contact our sales personnel.



Connect only devices using 24 VDC rated voltage.

- The rated output voltage of the UPS is 24 VDC.
- Overvoltage or overcurrent may damage the connected devices.



All the accessories contained in the product package can be used for the UPS only. Do not use any of them for other devices.

- Be sure to observe this to use the UPS safely.



Include a breaker between the “input power supply” of the UPS and the direct power supply equipment. And, install the breaker where it is easy to operate.



To use this product as a CE marking compliant device, use a 2-meter or shorter connection cable.



Do not block the air vents (upper and lower).

- Doing so will cause the internal temperature to rise, which may cause the unit to fail and the battery to deteriorate.
- For stationary installation, leave a space of 50 mm or more above the top, and for installation using a DIN rail and screw clamps, leave a space of 50 mm or more above the top and below the bottom each.



Do not connect the RS-232C port or the CONTACT port to a LAN device using a LAN cable.

- Connection to a LAN device may result in malfunction in or damage to the UPS or the LAN device.



(for use)

Do not allow the unit to come in contact with water. If you drop the unit, stop using it.

- Doing so may cause an electric shock or a fire.
- Doing so may cause an abnormal heating, smoke, rupture, or fire on the battery.
- If the unit becomes wet or is dropped, immediately stop using it, disconnect the input power supply from the wall outlet (commercial power source) and have it inspected and repaired.
- For details on repair, contact our sales personnel.



When the battery is dead, replace it immediately or stop using the unit.

- Continuing the use of it may cause fire or electric shock due to liquid leaks.



| Ambient temperature | Expected life |
|---------------------|---------------|
| 50°C | 2.5 years |
| 40°C | 5 years |
| 25°C | 10 years |

* The values in the table are the expected life under standard use conditions and are not guaranteed.

Occasionally, wipe off dust on the input terminal block and the output terminal block with a dry cloth.

- Accumulated dust may cause a fire.
- Before wiping off dust, stop all connected devices and the unit, and stop the supply of commercial power.



Do not use the unit in a closed place and do not cover the unit.

- Doing so may cause abnormal heating or a fire.



If you notice something unusual such as abnormal sound or smell, discoloration, deformation, and heating, turn OFF the unit’s “Power” switch to stop the output and stop the supply from the “input power supply”.

- Using the unit under such conditions may cause an abnormal heating, rupture or fire.
- If this situation arises, be sure to stop using the UPS and request our sales personnel for inspection and repair.
- A readily accessible disconnect device shall be incorporated external to the equipment.



If fluid leaks from the interior, do not touch the fluid.

- Doing so may cause blindness or burns.
- If the fluid contacts your eyes or skin, wash it out with lots of clean water and consult your doctor. The fluid may damage your eye if your eye is left untreated.



Do not place any objects on the unit, and do not drop heavy objects onto the unit.

- Doing so may cause distortion/damage to the case or a failure of the internal circuit, which may cause a fire.



The unit is equipped with a bypass circuit which is able to supply electric power to connected devices even when the inner control circuit is broken down by defects or malfunctions.

If you want to stop the output, stop the source of the “input power supply”.

- Output is continuing even when all indicators of the front panel are off.
- Output ON/OFF cannot be controlled with the “Power” switch on the front panel.



When charging the battery, if the battery cannot be charged completely even after the predetermined charging time, turn OFF the “Power” switch of the unit to stop charging the battery.

- Otherwise, it may cause an abnormal heating, smoke, rupture or fire on the battery.



(for maintenance)

When maintaining the connected equipment, turn OFF the unit's "Power" switch to stop the output, and stop the supply of the "input power supply".



- Even if the input power supply to the UPS is stopped while it is in operation, the power output of his unit does not stop and power is supplied from the battery.

Do not disassemble, repair, or modify the unit.

- Doing so may cause an electric shock or a fire.



If fluid leaks from the interior, do not touch the fluid.

- Doing so may cause blindness or burns.
- If the fluid contacts your eyes or skin, wash it out with lots of clean water and consult your doctor.



Do not throw the unit into fire.

- Since the battery is incorporated in the unit, the insulator may melt, the gas exhaust valve or protection mechanism may be damaged, or the electrolyte may catch fire, and it may result eventually in an abnormal heating, smoke, rupture or fire.



Do not insert metal objects into the input terminal block and the output terminal block of the UPS.

- Doing so may result in electric shock.



Do not insert metal objects into the battery connectors. Do not short between the connector terminals.

- Doing so may result in electric shock.
- The battery's protection board may be damaged due to a short-circuit.

**(for battery replacement)**

Risk of explosion if battery is replaced by an incorrect type.

- Not doing so may cause a fire.
- Battery pack for; product model: S8BA-B120L.



Do not replace the battery in a place where there is flammable gas.

- Spark may occur when connecting the battery, which may cause an explosion or fire.



If fluid leaks from the battery, do not touch the fluid.

- Doing so may cause blindness or burns.
- If the fluid contacts your eyes or skin, wash it out with lots of clean water and consult your doctor.



Do not disassemble or modify the battery.

- A safety mechanism and protection mechanism to prevent danger are embedded into the battery. If they are damaged, it may cause an abnormal heating, smoke, rupture or fire on the battery.



Do not drop the battery and do not expose it to strong impact.

- Doing so may cause a leakage, abnormal heating, smoke, rupture or fire on the battery. And, if the battery's protection mechanism is broken, the battery may be charged at an abnormal current or voltage, an abnormal chemical reaction may occur inside the battery, and it may result eventually in an abnormal heating, smoke, rupture or fire.



Do not short the battery with metal objects.

- Doing so could cause an electric shock, fire or burn.
- Some electrical energy still remains inside the spent battery.



Do not dispose of battery in a fire or damage battery.

- The insulator inside the battery may melt, the gas exhaust valve or protection mechanism may be damaged, or the electrolyte may catch fire, and it may result eventually in abnormal heating, smoke, rupture or fire.



Do not use a new battery and an old battery at the same time.

- The battery may be excessively discharged while being used or excessively charged while being charged, an abnormal chemical reaction may occur inside the battery, and it may result eventually in an abnormal heating, smoke, rupture or fire.
- A battery can present a risk of electrical shock and high short circuit current.
- Contact with any part of a grounded battery can result in electrical shock.
- The following precautions should be observed when working on batteries:
 - (a) Remove watches, rings, or other metal objects.
 - (b) Use screwdrivers with insulated handles.
 - (c) Wear rubber gloves and boots.
 - (d) Do not lay tools or metal parts on top of batteries.
 - (e) Remove the connection from ground if any part of the battery is determined to be grounded.



Dispose of or collect (recycle) the battery according to your own rules set for that purpose or as instructed by laws and regulations.



Do not dispose of it in fire. Otherwise, it could explode.

廢電池請回收



Precautions for Safe Use

Before using

Charge the battery soon after purchasing the unit.

- If not used for a long time after being purchased, the UPS may become unusable because the characteristics of its battery become inferior.
- Connect the UPS to the input power supply and turn ON the "Power" switch to charge the battery.

If the UPS is moved from a warm place to a cold place, start using it after leaving it as-is for a few hours.

- If the UPS is suddenly moved to a warm place, water may adhere to it (condensation). In such a case, if power is supplied without checking the condition, the UPS may be damaged.
- Take measures against the unexpected events such as protecting data and making the system redundant.
- The UPS may stop its power due to failure.

For Connection

Be careful not to let a short-circuit occur between output lines of the UPS and not to let an output line and the ground be short-circuited (a ground fault).

- Otherwise, the UPS may be damaged.

To transfer or sell the UPS to a third party, attach all the documents and other accessories contained in the product package to the UPS. It is supposed that the UPS is to be used in accordance with the conditions specified in the attached documents.

While Using the UPS

Turn OFF the "Power" switch of the UPS before turning OFF the input power supply.

- When the input power supply is stopped, backup operation starts.
- If the frequency of backup operation becomes high, the battery life may be significantly reduced.

Do not use the UPS for purposes requiring frequent backup operation.

- The battery will deteriorate and become unable to last for the specified backup time.

For Storage


To store the UPS for a long time, store it in an environment where the ambient temperature is 25°C or lower, and charge the battery once every year for 10 to 15 minutes.

- The battery discharges itself even if it is not used. If the battery is left unused for a long time, it goes into a state of over-discharge. In such a case, the backup time may become shorter, or the battery cannot be used anymore.
- We recommend an environment where the ambient temperature is 25°C or lower to store the UPS for a long time.
- Keep the "Power" switch of the UPS turned OFF during storage.
- Do not install or store the UPS in a location exposed to direct sunlight.
- The built-in battery may deteriorate rapidly due to an increase in temperature and become unusable.

Correct Installation Method


- For installation, to improve the long time reliability of the UPS, pay much attention to heat dissipation. Ensure convection of air around the UPS main body, and use the UPS in an operating condition below the derating curve.
- During machining work for mounting, make sure that no metal scrap goes into the product.
- The heat dissipation of the UPS may become worse depending on how the UPS is mounted; in rare cases, internal components may deteriorate and get damaged. Use the UPS in an operating condition based on the derating curve for each mounting direction.

Standard mounting (Mounting to the DIN rail)

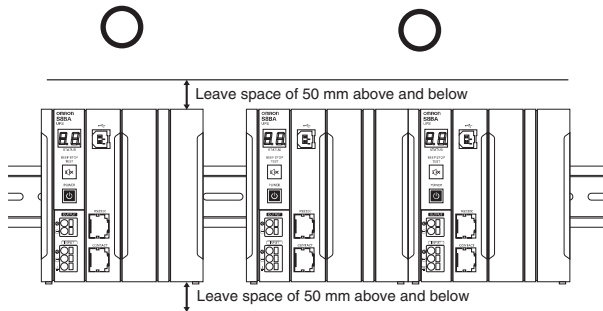


To install devices other than the UPS to both sides, install them by leaving a space specified by each device off the UPS.

Stationary mounting

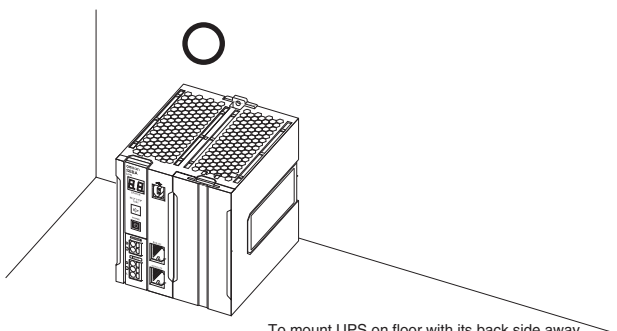


To mount UPS on floor with its back side away from you, mount it so that its back side is in contact with wall. (Because PCB is partially exposed in its back side, and UPS may be affected by static electricity for that reason.)

Face-up mounting

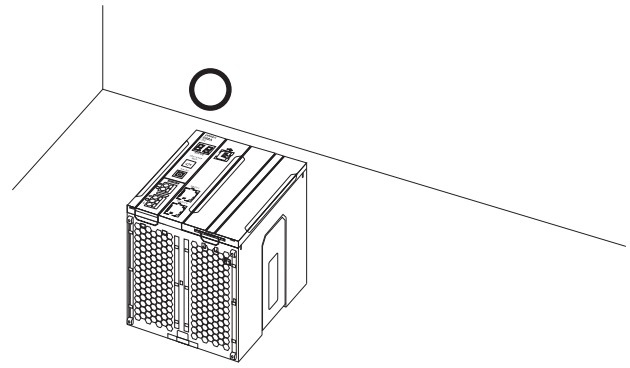


To mount UPS on floor with its top side away from you, mount it so that its top side is 50 mm or more off wall.

Incorrect Installation Method Mounting to the DIN Track

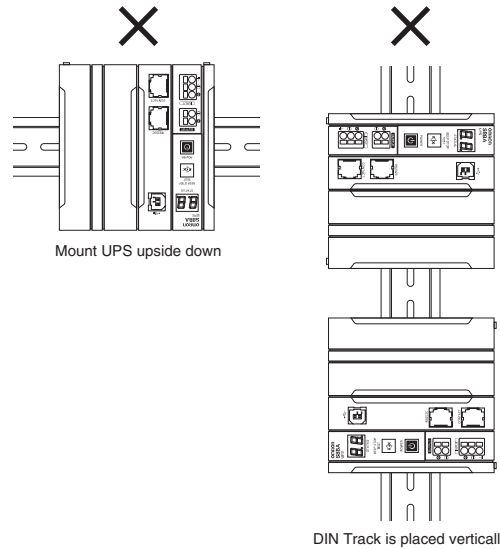

Stationary installation

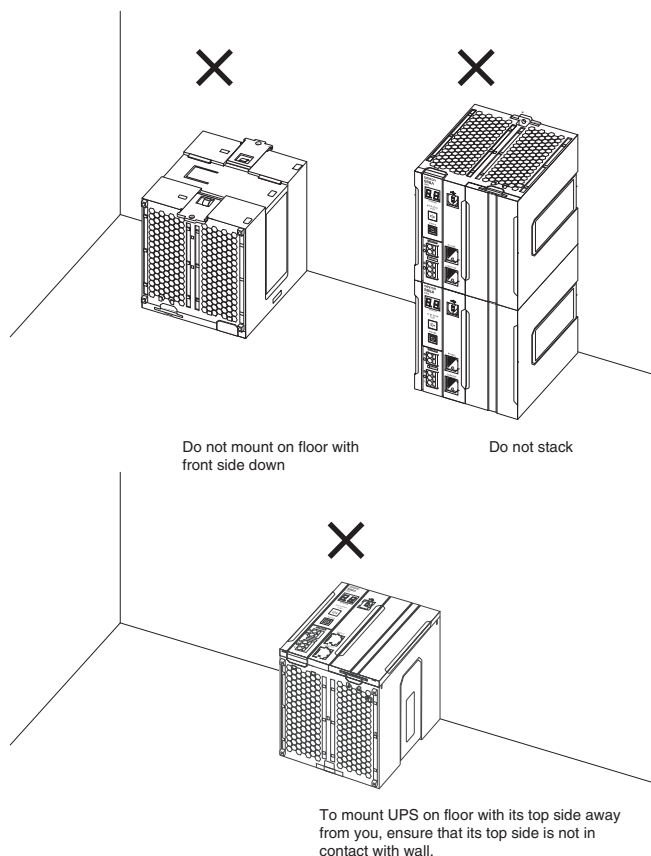

Battery Replacement

The UPS supports hot swapping. Battery replacement is possible both when the power is turned OFF (while the power output is OFF) and when the power is turned ON (while the power output is ON).

Precautions for Correct Use

- For battery replacement, hold down the “Buzzer Pause/Test” switch on the unit for 10 seconds or longer to activate the battery replacement mode. When “b.u.” is displayed, the activation is completed.
 - * Activate the battery replacement mode while the “input power supply” is turned ON. If you replace the battery without activating the battery replacement mode, the battery life may not be detected accurately because the battery life counter is not reset.
- Do not replace the battery during backup operation. Otherwise, the output stops.

The life of the battery used in the UPS is limited. This life changes depending on the use environment and the frequency of backup operation.

- As the battery life comes closer to its end, the battery deteriorates more rapidly. Be careful.

The storage condition also affects the deterioration of the battery. As the storage temperature becomes higher, the battery life becomes shorter. Be careful.

Battery check schedule and frequency

| Ambient temperature | 6-Month Inspection | 3-Month Inspection |
|---------------------|---|---|
| 55°C | Up to 1 year from the date of purchase | 1 year from the date of purchase and afterward |
| 50°C | Up to 1.5 years from the date of purchase | 1.5 years from the date of purchase and afterward |
| 40°C | Up to 3 year from the date of purchase | 3 years from the date of purchase and afterward |
| 25°C | Up to 6 year from the date of purchase | 6 years from the date of purchase and afterward |

Conformance to EC Directives

Applicable directives

- EMC Directives
- Low Voltage Directives

Principles regarding conformance

OMRON electronic devices that comply with EC Directives also conform to the related EMC standards so that they can be more easily built into other devices or the overall machine. The actual products have been checked for conformity to EMC standards*.

Whether the products conform to the standards in the system used by the customer, however, must be checked by the customer. EMC-related performance of the OMRON devices that comply with EC Directives will vary depending on the configuration, wiring, and other conditions of the equipment or control panel on which the OMRON devices are installed. The customer must, therefore, perform the final check to confirm that devices and the overall machine conform to EMC standards.

* Applicable EMC (Electromagnetic Compatibility) standards are as follows: EMS (Electromagnetic Susceptibility): EN 61000-6-2, EMI (Electromagnetic Interference): EN 61000-6-4, and EN 61000-6-4 Radiated emission: 10-m regulations

Low Voltage Directives

Always ensure that devices operating at voltages of AC 50 to 1,000 V and DC 75 to 1,500 V meet the required safety standards. The applicable directive is EN60950-1.

Conformance to EC Directives

This product complies with EC Directives. To ensure that the machine or device in which the this product is used complies with EC Directives, the product must be installed as follows:

- This product must be installed within a control panel.
- You must use reinforced insulation or double insulation for the direct power supply equipment connected to this product.
- Models of this product that comply with EC Directives also conform to the Common Emission Standard. Radiated emission characteristics (10-m regulations), in particular, may vary depending on the configuration of the control panel used, other devices connected to the control panel, wiring, and other conditions. Therefore, even when using a model of this product that complies with EC Directives, you must confirm and ensure the compliance to EC Directives of the entire machine or equipment.
- This is a Class A product (for industrial environments). In a residential environment, it may cause radio interference. If radio interference occurs, the user may be required to take appropriate measures.

Conformance to UL

Conformance to UL

- This product must be installed within a control panel with an internal heater or other unit to protect against the formation of condensation.
- Gaps in the door to the control panel must be completely filled or covered with gaskets or other material.
- For use as a UL compliant device, the specifications for S8BA-24D24D480LF become as follows:
 - Maximum input current: 20 A
 - Rated output current/capacity: 16.7 A/400 W
 - For use in Pollution Degree 2 Environment.
 - Surrounding Air Temperature, 55°C.
 - Make sure to connect the device with Class 2 output to the USB port.

Conformance to FCC

FCC CAUTION

Changes or modifications not expressly approved by the party responsible for compliance could void the user's authority to operate the equipment.

- This equipment has been tested and found to comply with the limits for a Class A digital device, pursuant to part 15 of the FCC Rules. These limits are designed to provide reasonable protection against harmful interference when the equipment is operated in a commercial environment.
- This equipment generates, uses, and can radiate radio frequency energy and, if not installed and used in accordance with the instruction manual, may cause harmful interference to radio communications.
- Operation of this equipment in a residential area is likely to cause harmful interference in which case the user will be required to correct the interference at his own expense.

Conformance to KC

A 급 기기 (업무용 방송통신기자재)
이 기기는 업무용(A 급) 전자파적합기기로서 판매자
또는 사용자는 이 점을 주의하시기 바라며, 가정외의
지역에서 사용하는 것을 목적으로 합니다.

Uninterruptible Power Supply (UPS) Separated battery type S8BA-SBF

DC-DC type small UPS mounts on a DIN rail to provide an ideal countermeasure for momentary power losses and power failures in industrial computers (IPC) and controllers.



- System reliability greatly improved because 24VDC power supply is backed up for a certain period of time in the event of voltage drop or power failure.
- Compactness, weight reduction, and long battery life realized thanks to the adoption of a lithium-ion battery.
- Push-in terminal block adopted for the power input and output I/F.
- Shutdown in conjunction with the industrial purpose computer (IPC) or controller realized by the USB/RS-232C/I/O port installed in the UPS.
- Two types of batteries are selectable for the 480W, allowing the ideal backup time to be realized
- A wide lineup culminating in the 960W makes it possible to provide long-lasting backup for every type of industrial controller

⚠ Refer to *Safety Precautions* on page 33.

Model Number Structure

Model Number Legend * Use the following format to place an order.
The control unit and battery unit are separate, and the battery unit is sold separately.

Control unit part

S8BA- □□□□□□□□□□ SBF

Series name 1 2 3

| 1. Input voltage specification | | 2. Output voltage | | 3. Capacity | |
|--------------------------------|-----------------------------|-------------------|----------------|-------------|----------|
| Code | Input voltage specification | Code | Output voltage | Code | Capacity |
| 24D | 24 VDC | 24D | 24 VDC | 480 | 480 W |
| | | | | 960 | 960 W |

Battery unit part

S8BA- □□□□□ L

Series name 1 2

| 1. Battery type | | 3. Terminal block shape | |
|-----------------|------------------------|-------------------------|----------------------|
| Code | Type | Code | Terminal block shape |
| S | Separated battery type | 480 | 480 W |
| | | 960 | 960 W |

S8BA-SBF

Ordering Information

Main body

Uninterruptible Power Supply (UPS) / Control Unit Part

| Input voltage | Output voltage | Output current/capacity | Model number |
|---------------|----------------|-------------------------|--------------------------|
| 24 VDC | 24 VDC | 20 A/480 W | S8BA-24D24D480SBF |
| | | 40 A/960 W | S8BA-24D24D960SBF |

Note: The control unit (960 W) and the battery unit (480 W) cannot be connected.

Battery unit part

| Rated voltage | Rated capacity | Weight | Model | UPS Model : Required units |
|---------------|----------------|--------|-------------------|----------------------------|
| 25.2 VDC | 3900 mAh | 1.5 kg | S8BA-S480L | S8BA-24D24D480SBF |
| 25.2 VDC | 7800 mAh | 2.5 kg | S8BA-S960L | S8BA-24D24D960SBF |

Note: The control unit (960 W) and the battery unit (480 W) cannot be connected.

Communication cable

| Specifications | Type | Length | Model number |
|------------------|--------------------|--------|-----------------|
| For RS-232C port | RJ45/Dsub9Pin | 2 m | S8BW-C01 |
| For CONTACT port | RJ45/Discrete wire | | S8BW-C02 |

Ratings, Characteristics, and Functions

| Description | | Capacity | 480 W | 960 W | |
|---|--|--|---|---|--|
| DC input | Rated input voltage | | 24 VDC | | |
| | Input voltage range | | 23 to 28 VDC | | |
| | Input maximum current | for rated input voltage for rated loads connected | 21.5 A | 43.5 A | |
| | Input terminal | | Push-in terminal block | | |
| | Input protection | | Fuse (cannot be replaced by the customer) | | |
| | Input protection capacity | | 30 A | 60 A | |
| DC output | Rated current | for rated output voltage | 20 A | 40 A | |
| | Switching time | | Uninterrupted | | |
| | Output voltage | Normal operation | Input voltage through output | | |
| | | Backup operation | 21 to 28 V (the voltage cannot be adjusted) | | |
| | Output terminal | | Push-in terminal block | | |
| | Overload protection | Warning display • UPS output will continue through bypass [during normal operation] • UPS output will continue through battery [during backup operation] | | 101% or more | |
| | | Output stopped by overload protection • Stop output [during normal operation] • The internal power supply to the UPS will stop after 10 sec. [during backup operation] | | 111% or more | |
| Warning display cancellation (During normal operation, during backup operation) | | 93% or more | | | |
| Battery unit | Type | | Lithium-ion battery | | |
| | Rated voltage | | 25.2 VDC | | |
| | Rated capacity | | 3900 mAh | 7800 mAh | |
| | Battery life expectancy *1 | | 10 years (25°C), 6.7 years (35°C), 3.7 years (45°C), 1.9 years (55°C) | | |
| | Replacement by user | | Yes (Hot swapping) | | |
| | Battery Life Counter Function | | Yes | | |
| | Charging time | | 8 hours (90%) *3 | | |
| | Backup time (25°C, initial characteristics) | | 6 min. (constant power rated load) The backup time can be set from the mode selection / backup operation time selection switch, or the shutdown software. | | |
| Environment | Operating environment temperature / humidity | | 0 to +55°C / 10 to 90%RH with no condensation | | |
| | Storage environment temperature / humidity | | -20 to +55°C / 10 to 90%RH with no condensation | | |
| | Vibration resistance | | JIS C 60068-2-6 compliant 5 to 8.4 Hz amplitude: 3.5 mm, 8.4 to 150 Hz acceleration rate: 9.8 m/s ² X, Y, and Z directions: 100 min. (Sweep time: 10 min. x Sweep count 10 times = Total: 100 min.) | | |
| | Shock resistance | | JIS C 60068-2-27 compliant: 147 m/s ² X, Y, and Z directions three times | | |
| Structure | Dimensions (W×H×D mm) *2 | | 44 × 124 × 111.4 (UPS control unit 20 A) 80 × 124 × 111.4 (battery unit 20 A) | 52 × 124 × 111.4 (UPS control unit 40 A) 150 × 124 × 111.4 (battery unit 40 A) | |
| | Weight | Weight of control unit | Approx. 0.6 kg | Approx. 0.7 kg | |
| | | Weight of battery unit | Approx. 1.5 kg | Approx. 2.5 kg | |
| Cooling method | | Natural cooling | | | |
| Dielectric breakdown voltage | Withstand voltage | | DC external terminals to casing: 510 V AC, 1 minute, leakage current 5 mA max. | | |
| | Insulation resistance | | DC external terminals to casing: 20 MΩ or more. (500 V DC) | | |
| Standard compliance | Safety standard | | UL508 / CE / C22.2 No. 107.1-01 | | |
| | EMI | Radiation disturbance field strength | EN61000-6-4 / FCC / ICES / RCM / KC / EAC | | |
| Internal power consumption (normal *4 / maximum *5) | | 7 W / 29 W | 15 W / 58 W | | |
| Serial communication | RS-232C (Interface terminal) | | | | |
| | USB (Interface terminal) | | Yes (RJ45) | | |
| I/O signal (Interface terminal) | | Yes (RJ45) | | | |
| Accessories | | USB cable (2.2 m) (included with control unit) Battery connection cable (included with battery unit) | | | |

S8BA-SBF

| Description | Capacity | 480 W | 960 W |
|---------------------|----------|---|-------|
| Accessory functions | | Remote ON/OFF signal logic setting; Battery life counter setting; Maximum backup time setting; Startup battery level setting; Backup stop (BS) signal delay time setting; and Backup (BU) signal delay time setting | |

*1. Guideline for a standard installation. Not a guaranteed value.

*2. Unit dimensions excluding the DIN rail stopper.

*3. When using in an environment at a high temperature, charging may be paused by charging temperature protection, then the charging time will be longer than specified time.


*4. Conditions: With rated loads connected, at a rated input voltage, and at a full battery charge.

*5. Conditions: With rated loads connected, at a rated input voltage and at maximum battery charging current.


Nomenclature

Front view

S8BA-24D24D480SBF

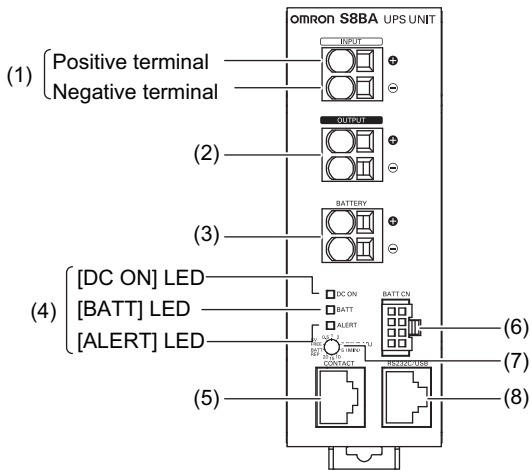


S8BA-S480L

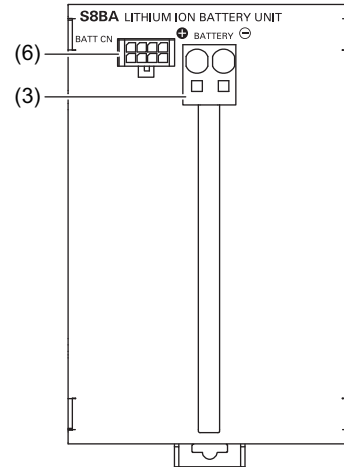


| No. | Name | No. | Name |
|-----|-----------------------------------|-----|---|
| (1) | DC input terminal block | (5) | CONTACT port |
| (2) | DC output terminal block | (6) | Battery communication port |
| (3) | Battery connection terminal block | (7) | Mode selection / Backup time setting switch |
| (4) | LED indicators | (8) | RS232C / USB port |

S8BA-24D24D960SBF

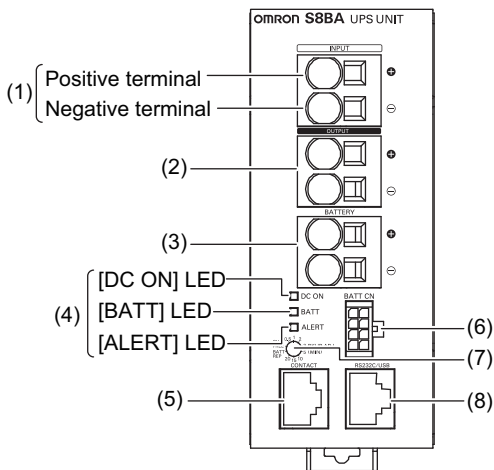

S8BA-S960L

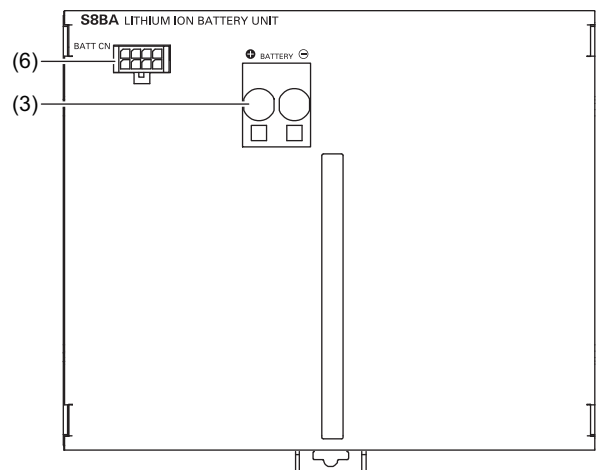


| No. | Name | No. | Name |
|-----|-----------------------------------|-----|---|
| (1) | DC input terminal block | (5) | CONTACT port |
| (2) | DC output terminal block | (6) | Battery communication port |
| (3) | Battery connection terminal block | (7) | Mode selection / Backup time setting switch |
| (4) | LED indicators | (8) | RS232C / USB port |


S8BA-SBF

Rear view

S8BA-24D24D480SBF

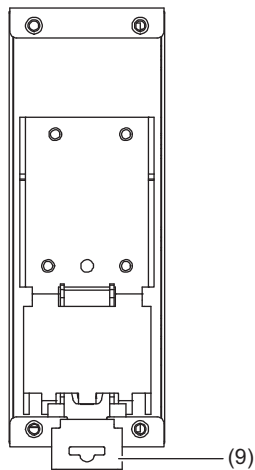


S8BA-S480L

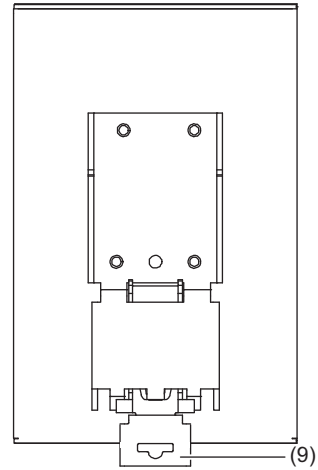


| No. | Name |
|-----|---------------|
| (9) | DIN rail hook |

S8BA-24D24D960SBF

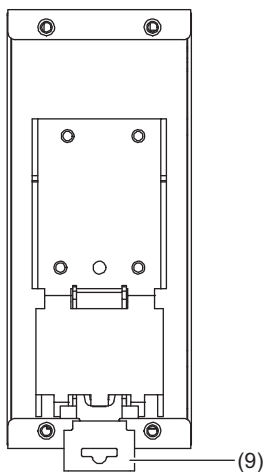

S8BA-S960L

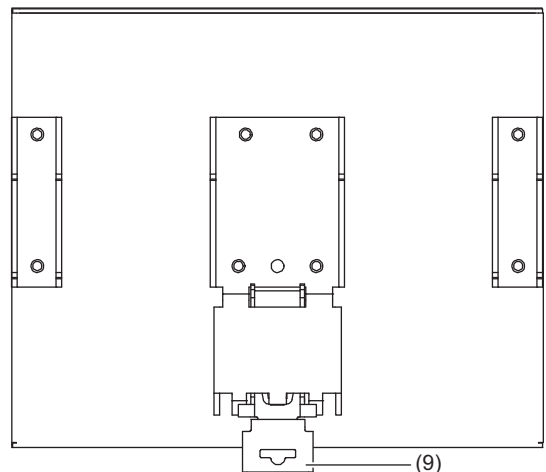


| No. | Name |
|-----|---------------|
| (9) | DIN rail hook |

Connections


Block Diagrams

S8BA-24D24D□□□SBF

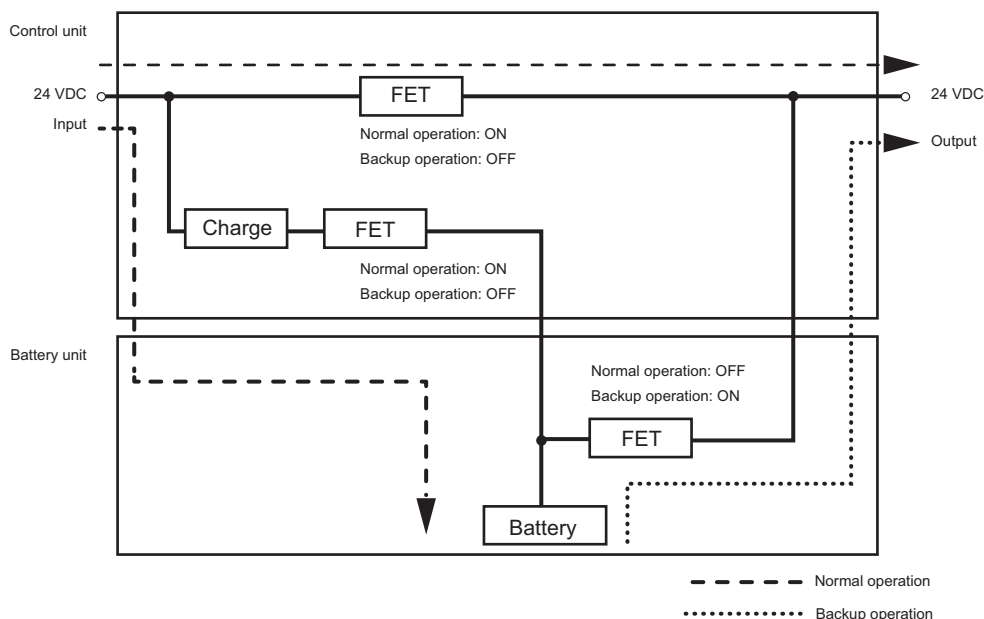

Note: 1. In normal operation, 24 VDC is output as-is for charging the battery and from the input power supply. If the 24 VDC from the input power supply becomes lower, the operation automatically switches to backup operation, and 24 VDC is output from the battery.

Input and output voltage time chart when shifting to backup operation

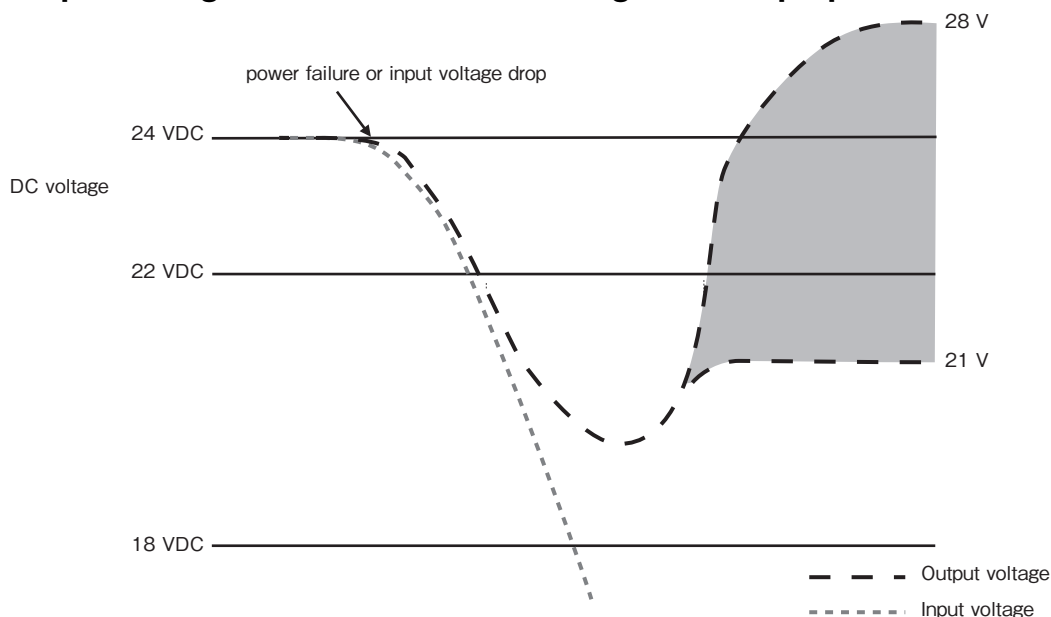

Connecting a cable to the input terminal block and the output terminal block

For details about the connectable sizes and recommended cable sizes, see the following table.

| | | 20 A | | 40 A | |
|--|-------|----------------------------|---------------------------|------------------------------|--|
| Connectable sizes | Cable | Solid wire | 0.2 to 10 mm ² | 0.75 to 16.0 mm ² | |
| | | Stranded wire | 0.2 to 6 mm ² | | |
| | | AWG | AWG 8 to 24 | | |
| Stripped cable length | | 8 to 10 mm | | 18 mm | |
| Recommended sizes | Cable | Solid wire / Stranded wire | 2.0 mm ² | 8.0 to 14.0 mm ² | |
| | | AWG | AWG 12 | AWG 6 to 8 | |
| Temperature rating for recommended cable | | | 90°C | | |