



Chipsmall Limited consists of a professional team with an average of over 10 year of expertise in the distribution of electronic components. Based in Hongkong, we have already established firm and mutual-benefit business relationships with customers from,Europe,America and south Asia,supplying obsolete and hard-to-find components to meet their specific needs.

With the principle of “Quality Parts,Customers Priority,Honest Operation,and Considerate Service”,our business mainly focus on the distribution of electronic components. Line cards we deal with include Microchip,ALPS,ROHM,Xilinx,Pulse,ON,Everlight and Freescale. Main products comprise IC,Modules,Potentiometer,IC Socket,Relay,Connector.Our parts cover such applications as commercial,industrial, and automotives areas.

We are looking forward to setting up business relationship with you and hope to provide you with the best service and solution. Let us make a better world for our industry!



Contact us

Tel: +86-755-8981 8866 Fax: +86-755-8427 6832

Email & Skype: info@chipsmall.com Web: www.chipsmall.com

Address: A1208, Overseas Decoration Building, #122 Zhenhua RD., Futian, Shenzhen, China





REDUNDANCY MODULE

- Cost Effective Solution to Build Redundant Systems
- Dual Input with Single Output
- Alarm Relay-contacts for Each Input Path
- Two Diodes (Common Cathode)
- DC 24-48V $\pm 25\%$ (18-60Vdc) Wide-range Input
- Full Power Between -40°C and $+60^{\circ}\text{C}$
- Width only 32mm
- Rugged Metal Housing
- Large Screw Terminals
- Easy Wiring:
Distribution Terminal for Negative Pole Included
- 3 Year Warranty

GENERAL DESCRIPTION

The YRM2.DIODE is a redundancy module, which can be used to build 1+1 and N+1 redundant systems. It is equipped with two input channels, which can be connected to power supplies with up to 10A output current and one output, which can carry nominal currents up to 20A. The module is suitable for power supplies with constant current overload behavior as well as any kind of "Hiccup" overload behavior.

The YRM2.DIODE has a monitoring circuit included and is the perfect solution when the power supply has no DC-OK function. Two LEDs and two relay contacts signal when one of the two DC-input voltages is not in range due to a non-functioning or disconnected power supply.

In addition to the YRM2.DIODE is the YR2.DIODE which has no monitoring circuitry included. This is the perfect fit when the power supply itself is already equipped with a DC-OK signal (e.g.: DIMENSION Q-Series).

Large screw terminals allow an easy installation and a huge international approval package for a variety of applications makes this unit suitable for nearly every situation.

SHORT-FORM DATA

| | | |
|------------------------------|---|--|
| Input voltage | DC 24-48V | $\pm 25\%$ |
| Input voltage range | 18-60Vdc | |
| Input current | 2x 0-10A 2x 0-16A | continuous for 5 seconds |
| Output current | 0-20A 20-32A 25A | continuous for 5 seconds at cont. overload/ short circuit |
| Input to output voltage drop | typ. 0.78V typ. 0.85V typ. 0.85V | input: 2x5A input: 1x10A input: 2x10A |
| Power losses | typ. 1.0W typ. 8.8W typ. 9.5W typ. 18W | at no load input: 2x5A input: 1x10A input: 2x10A |
| Temperature range | -40°C to $+70^{\circ}\text{C}$ | operational, |
| Derating | 0.5A/ $^{\circ}\text{C}$ | $+60$ to $+70^{\circ}\text{C}$ |
| Dimensions | 32x124x117mm | WxHxD |

ORDER NUMBERS

| | | |
|-------------------|-------------------|---------------------------|
| Redundancy Module | YRM2.Diode | 24-48V Standard unit |
| Accessory | ZM1.WALL | Wall/ panel mount bracket |
| | ZM11.SIDE | Side mount bracket |

MARKINGS




INDEX

| Page | Page |
|--|--|
| 1. Intended Use3 | 15. Approvals..... 12 |
| 2. Installation Requirements.....3 | 16. Physical Dimensions and Weight..... 13 |
| 3. Input and Output Characteristics4 | 17. Accessories 14 |
| 4. Power Losses.....5 | 18. Application Notes..... 15 |
| 5. Alarm Contacts.....5 | 18.1. Recommendations for Redundancy..... 15 |
| 6. Lifetime Expectancy and MTBF.....6 | 18.2. Inductive and Capacitive Loads..... 15 |
| 7. Terminals and Wiring.....7 | 18.3. Example: 1+1 Redundancy up to 10A..... 15 |
| 8. Functional Diagram.....8 | 18.4. Example: N+1 Redundancy up to 30A 16 |
| 9. Front Side and User Elements.....8 | 18.5. Example: Battery Back-up 16 |
| 10. EMC.....9 | 18.6. Example: Redundancy for Controls 17 |
| 11. Environment 10 | 18.7. Example: Decoupling of Branches 18 |
| 12. Protection Features 11 | 18.8. Use in a Tightly Sealed Enclosure 18 |
| 13. Safety Features..... 11 | 18.9. Mounting Orientations 19 |
| 14. Dielectric Strength 11 | |

The information presented in this document is believed to be accurate and reliable and may change without notice. No part of this document may be reproduced or utilized in any form without permission in writing from the publisher.

TERMINOLOGY AND ABBREVIATIONS

| | |
|--|--|
| PE and \oplus symbol | PE is the abbreviation for Protective Earth and has the same meaning as the symbol \oplus . |
| Earth, Ground | This document uses the term "earth" which is the same as the U.S. term "ground". |
| T.b.d. | To be defined, value or description will follow later. |
| DC 24V | A figure displayed with the AC or DC before the value represents a nominal voltage with standard tolerances (usually $\pm 15\%$) included. E.g.: DC 12V describes a 12V battery disregarding whether it is full (13.7V) or flat (10V) |
| 24Vdc | A figure with the unit (Vdc) at the end is a momentary figure without any additional tolerances included. |
| may | A key word indicating flexibility of choice with no implied preference |
| shall | A key word indicating a mandatory requirement |
| should | A key word indicating flexibility of choice with a strongly preferred implementation |
| 1+1 Redundancy | Use of two identical power supplies in parallel to provide continued operation following most failures in a single power supply. The two power supply outputs should be isolated from each other by utilizing diodes or other switching arrangements. E.g. two 10A power supplies are needed to achieve a 10A redundant system. |
| N+1 Redundancy | Use of three or more identical power supplies in parallel to provide continued operation following most failures in a single power supply. All power supply outputs should be isolated from each other by utilizing diodes or other switching arrangements. E.g.: To achieve a 40A redundant system, five 10A power supplies are needed in a N+1 redundant system. |

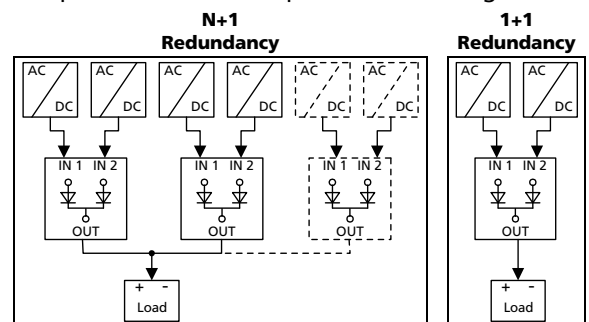

1. INTENDED USE

This redundancy module is designed for installation in an enclosure and is intended for the general use such as in industrial control, office, communication, and instrumentation equipment.

This redundancy module can be used with any type of power supply as long as the maximum ratings are not exceeded. It is suitable for power supplies with constant current overload behavior as well as any kind of "Hiccup" overload behavior.

Do not use this redundancy module in equipment, where malfunction may cause severe personal injury or threaten human life.

This device is designed for use in hazardous, non-hazardous, ordinary or unclassified locations.

2. INSTALLATION REQUIREMENTS

This device may only be installed and put into operation by qualified personnel.

This device does not contain serviceable parts.

If damage or malfunction should occur during installation or operation, immediately turn power off and send unit to the factory for inspection.

Mount the unit on a DIN-rail so that the input terminals are located on the top and the output terminals on the bottom of the unit. For other mounting orientations see de-rating requirements of chapter 18.9. in this document.

This device is designed for convection cooling and does not require an external fan. Do not obstruct airflow and do not cover the ventilation grid (e.g. cable conduits) by more than 30%!

Keep the following installation clearances:

40mm on top,

20mm on the bottom,

5mm on the left and right sides are recommended when the device is loaded permanently with more than 50% of the rated output current. Increase the side clearance to 15mm in case the adjacent device is a heat source (e.g. another power supply).



WARNING Risk of electrical shock, fire, personal injury or death.

- Turn power off before working on the device. Protect against inadvertent re-powering.
- Make sure that the wiring is correct by following all local and national codes.
- Do not open, modify or repair the unit.
- Use caution to prevent any foreign objects from entering the housing.
- Do not use in wet locations or in areas where moisture or condensation can be expected.
- Do not touch during power-on, and immediately after power-off. Hot surfaces may cause burns.

Notes for use in hazardous location areas:

The redundancy module is suitable for use in Class I Division 2 Groups A, B, C, D locations and for use in Group II Category 3 (Zone 2) environments and is evaluated according to EN 60079-0:2009 and EN 60079-15:2010.

WARNING EXPLOSION HAZARDS!

Substitution of components may impair suitability for this environment. Do not disconnect the unit unless power has been switched off or the area is known to be non-hazardous.

A suitable enclosure must be provided for the end product which has a minimum protection of IP54 and fulfils the requirements of the EN 60079-15:2010.

3. INPUT AND OUTPUT CHARACTERISTICS

| | | | |
|-------------------------------|------|-----------|--|
| Number of inputs | - | 2 | |
| Number of outputs | - | 1 | |
| Input voltage | nom. | DC 24-48V | ±25% The input circuitry must meet the SELV requirements stipulated by IEC/EN/UL 60950-1. |
| Input voltage range | - | 18-60Vdc | |
| Voltage drop, input to output | typ. | 0.78V | at 2x5A, see Fig. 3-1 |
| | typ. | 0.85V | at 1x10A, see Fig. 3-2 |
| | typ. | 0.85V | at 2x10A, see Fig. 3-1 |
| Input current | nom. | 2x 0-10A | continuous |
| | nom. | 1x 0-20A | continuous, see note 1 |
| | nom. | 2x 10-16A | for up to 5 seconds |
| Peak input current | max. | 150A | for maximal 10ms per input |
| Output current | nom. | 20A | continuous |
| | nom. | 20-32A | for up to 5 seconds |
| | max. | 25A | at continuous overload or short circuit, see note 2 |
| Reverse current | max. | 2mA | per input, -40°C to +60°C |
| Reverse voltage | max. | 200Vdc | voltage applied to the output, continuously allowed |

Note 1: Each input can be loaded up to 20A. At currents above 10A, the other input should not be loaded. It is preferable to parallel the two inputs in order to minimize the power loss in such cases.

Note 2: Ensure that the continuous output current does not exceed 25A. Check the short-circuit current of the power sources and if the power source can deliver more than 25A together, use an appropriate fuse on the output.

Fig. 3-1 **Input to output voltage drop when both inputs draw current**
(typical 1+1 redundant case, when the output voltages of the two units are equal or set into "parallel use" mode)


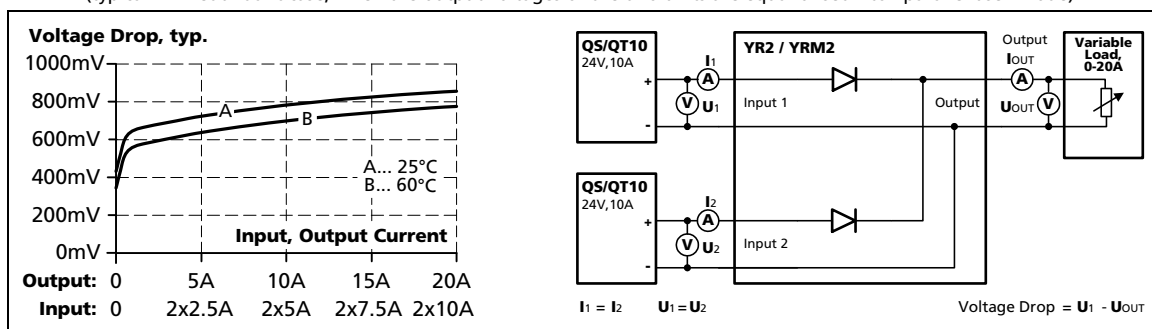



Fig. 3-2 **Input to output voltage drop when only one input draws current**

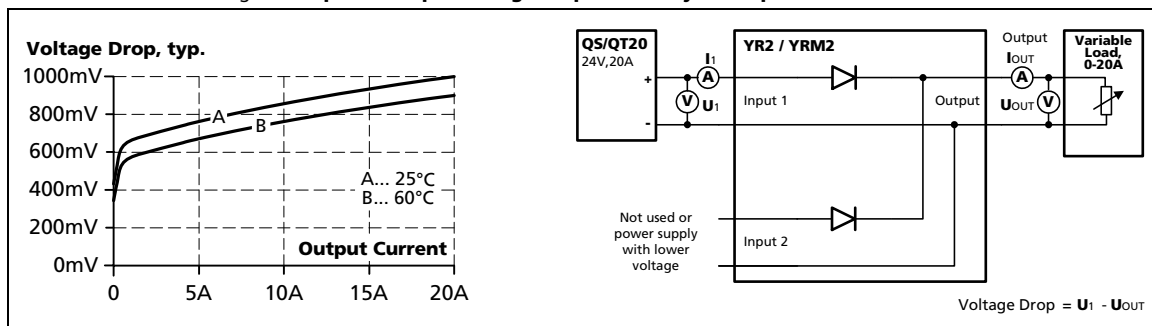

4. POWER LOSSES

| DC 24V | | | |
|----------------------|------|-------|----------------------|
| Power losses | typ. | 8.8W | input: 2x5A |
| | typ. | 9.5W | input: 1x10A |
| | typ. | 18.0W | input: 2x10A |
| Standby power losses | typ. | 1.0W | at no output current |

Fig. 4-1 Power losses

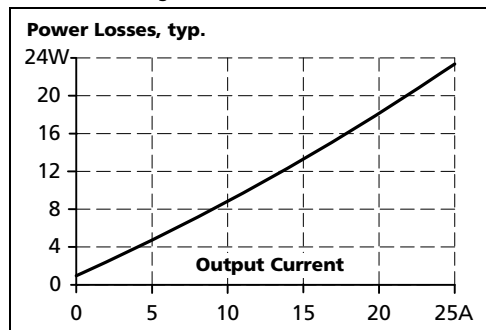

5. ALARM CONTACTS

Both input voltages are monitored individually. If one input voltage is too low or completely lost, it will be indicated by an alarm relay contact.

Each input has its own monitoring circuitry and relay contact.

| | | | |
|-------------------|--|----------------------------------|---|
| Alarm threshold | nom. | 21.5V ($\pm 0.5V$) | Relay contact opens immediately after the input voltage falls below this value. |
| Contact ratings | min. | 60Vdc 0.3A, 30Vdc 1A, 30Vac 0.5A | input: 1x10A |
| | max. | 1mA at 5Vdc | input: 2x10A |
| Isolation voltage | see dielectric strength table in section 14. | | |

6. LIFETIME EXPECTANCY AND MTBF

The redundancy module has two input channels which are completely independent from each other. Each control circuit, auxiliary voltage source, or other circuitry in the module are designed separately for each input. The dual input redundancy module can be considered as two single redundancy modules combined together in one housing. The only common point is the circuit trace that ties the two separate circuits together at the output.

The MTBF figures below are for the entire dual input module. If the MTBF number of only one path is needed, simply double the value from the table.

The redundancy module does not have electrolytic capacitors included. Therefore, the lifetime expectancy is extremely high.

| Input / output current conditions | | Input: 2x10A Output: 20A | Input: 2x5A Output: 10A | |
|-----------------------------------|------|-----------------------------|----------------------------|--------------------------------------|
| Lifetime expectancy *) | min. | 25 years | 25 years | at 24V and 40°C |
| | min. | 25 years | 25 years | at 24V and 25°C |
| MTBF **) SN 29500, IEC 61709 | | 9 100 000h | 10 900 000h | at 24V 40°C |
| | | 15 700 000h | 18 800 000h | at 24V 25°C |
| MTBF **) MIL HDBK 217F | | 9 200 000h | 11 100 000h | at 24V and 40°C (Ground Benign GB40) |
| | | 12 600 000h | 15 100 000h | at 24V and 25°C (Ground Benign GB25) |
| | | 3 380 000h | 4 060 000h | at 24V and 40°C (Ground Fixed GF40) |
| | | 4 630 000h | 5 570 000h | at 24V and 25°C (Ground Fixed GF25) |

*) The **Lifetime expectancy** shown in the table indicates the minimum operating hours (service life).

) **MTBF stands for **Mean Time Between Failure**, which is calculated according to statistical device failures, and indicates reliability of a device. It is the statistical representation of the likelihood of a unit to fail and does not necessarily represent the life of a product. The MTBF figure is a statistical representation of the likelihood of a device to fail. A MTBF figure of e.g. 1 000 000h means that statistically one unit will fail every 100 hours if 10 000 units are installed in the field. However, it can not be determined if the failed unit has been running for 50 000h or only for 100h.


7. TERMINALS AND WIRING

| | Input and output terminals | Alarm-signal terminals |
|-------------------------------|---|--|
| Type | Screw terminals IP20 Finger safe construction. Suitable for field installation. | Screw terminals, pluggable IP20 Finger safe construction. Suitable for field installation. |
| Solid wire | 0.5-6mm ² | 0.2-1.5mm ² |
| Stranded wire | 0.5-4mm ² | 0.2-1.5mm ² |
| American Wire Gauge | 20-10 AWG | 22-14 AWG |
| Max. wire diameter | 2.8mm (including ferrule) | |
| Wire stripping length | 7mm / 0.28inch | 6mm / 0.25inch |
| Screwdriver | 3.5mm slotted or Pozidrive No 2 | 3mm slotted |
| Recommended tightening torque | 0.8Nm / 7lb.in | 0.4Nm / 3.5lb.in |

Instructions:

- a) The external circuitry of all terminals (including signalling contacts) must meet the safety requirements stipulated by IEC/EN/UL 60950-1: SELV.
- b) Use appropriate copper cables that are designed for minimum operating temperatures of:
60°C for ambient up to 45°C and
75°C for ambient up to 60°C minimum.
- c) Follow national installation codes and installation regulations!
- d) Ensure that all strands of a stranded wire enter the terminal connection!
- e) Screws of unused terminal compartments should be securely tightened.
- f) Ferrules are allowed.
- g) Do not connect or disconnect the wires from the terminals below -25°C (-13°F).

8. FUNCTIONAL DIAGRAM

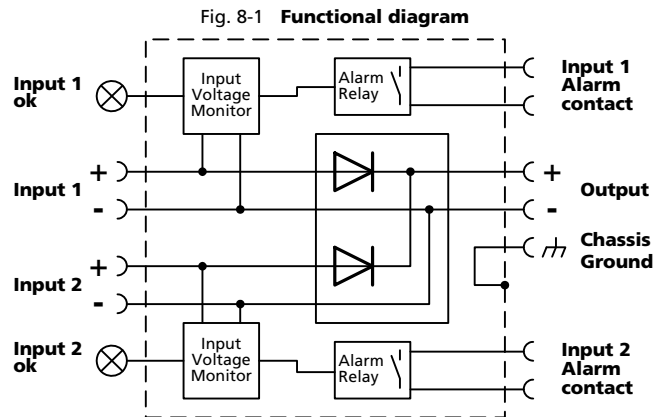

9. FRONT SIDE AND USER ELEMENTS

Fig. 9-1 Front side



A Output terminals

B Chassis ground terminal

Connection of the chassis to ground is optional and not required since the unit fulfils the requirements according to protection class III.

C Input terminals for input 1

D Input terminals for input 2

E Alarm-signal terminals for input 1 monitoring (relay contact)

F Alarm-signal terminals for input 2 monitoring (relay contact)

G Green LED for input 1 (LED is on, when input voltage is in range)

H Green LED for input 2 (LED is on, when input voltage is in range)

10. EMC

The redundancy module is suitable for applications in industrial environment as well as in residential, commercial and light industry environment without any restrictions. A detailed EMC report is available on request.

| EMC Immunity | | According generic standards: EN 61000-6-1 and EN 61000-6-2 | | |
|-----------------------------------|--------------|--|-------|-------------|
| Electrostatic discharge | EN 61000-4-2 | Contact discharge | 8kV | Criterion A |
| | | Air discharge | 15kV | Criterion A |
| Electromagnetic RF field | EN 61000-4-3 | 80MHz-2.7GHz | 10V/m | Criterion A |
| Fast transients (Burst) | EN 61000-4-4 | Input lines | 2kV | Criterion A |
| | | Output lines | 2kV | Criterion A |
| | | Alarm contacts | 2kV | Criterion A |
| Surge voltage on input lines | EN 61000-4-5 | +/- → Chassis ground | 1kV | Criterion A |
| Surge voltage on output lines | EN 61000-4-5 | +/- → Chassis ground | 1kV | Criterion A |
| Surge voltage on alarm contacts | EN 61000-4-5 | Alarm contact → Chassis ground | 1kV | Criterion A |
| Conducted disturbance | EN 61000-4-6 | 0.15-80MHz | 10V | Criterion A |
| Power-frequency magnetic field *) | EN 61000-4-8 | 50Hz | 30A/m | Criterion A |

Criteria:

A: Redundancy module shows normal operation behavior within the defined limits.

Notes:

*) A test is not applicable according to EN 61000-6-2, since the device does not contain components susceptible to magnetic fields, e.g. hall elements, electrodynamic microphones, etc.

| EMC Emission | | According generic standards: EN 61000-6-3 and EN 61000-6-4 | |
|---------------------|------------------------------------|--|--|
| Conducted emission | IEC/CISPR 16-1-2, IEC/CISPR 16-2-1 | Class B, input lines *) | |
| | IEC/CISPR 16-1-2, IEC/CISPR 16-2-1 | Class B, output lines *) | |
| Radiated emission | EN 55011, EN 55022 | Class B | |

This device complies with FCC Part 15 rules.

Operation is subjected to following two conditions: (1) this device may not cause harmful interference, and (2) this device must accept any interference received, including interference that may cause undesired operation.

*) Provided, that power sources connected on the inputs fulfill the class B requirements too.

11. ENVIRONMENT

| | | |
|----------------------------|--|---|
| Operational temperature *) | -40°C to +70°C (-40°F to 158°F) | Reduce output power above +60°C |
| Output de-rating | 0.5A/°C | 60-70°C (140°F to 158°F), see |
| Storage temperature | -40 to +85°C (-40°F to 185°F) | for storage and transportation |
| Humidity **) | 5 to 95% r.H. | IEC 60068-2-30 |
| Vibration sinusoidal ***) | 2-17.8Hz: ±1.6mm 17.8-500Hz: 2g 2 hours / axis | IEC 60068-2-6 |
| Shock ***) | 30g 6ms, 20g 11ms 3 bumps / direction 18 bumps in total | IEC 60068-2-27 |
| Altitude | 0 to 6000m (0 to 6 560ft) 2000 to 6000m (6 560 to 20 000ft) | without any restrictions reduce output power or ambient temperature, see Fig. 11-2 |
| Altitude de-rating | 1.25A/1000m or 5°C/1000m | > 2000m (6500ft), see Fig. 11-2 |
| Over-voltage category | not applicable | The concept of the overvoltage category is used for equipment energized directly from the low voltage mains (IEC 60664-1 §4.3.3.2.1). |
| Degree of pollution | 2 | IEC 62103, EN 50178, not conductive |
| LABS compatibility | The unit does not release any silicone or other LABS-critical substances and is suitable for use in paint shops. | |

*) Operational temperature is the same as the ambient temperature and is defined as the air temperature 2cm below the unit.

***) Do not energize while condensation is present

***) Tested in combination with DIN-Rails according to EN 60715 with a height of 15mm and a thickness of 1.3mm and standard mounting orientation.

Fig. 11-1 Output current vs. ambient temp.


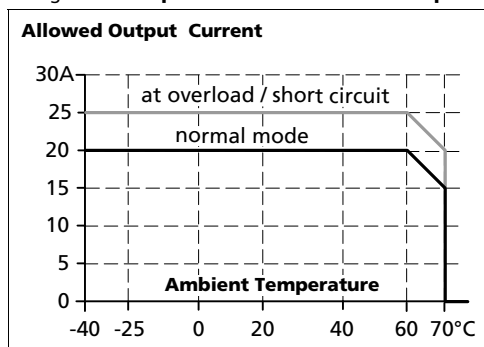


Fig. 11-2 Output current vs. altitude

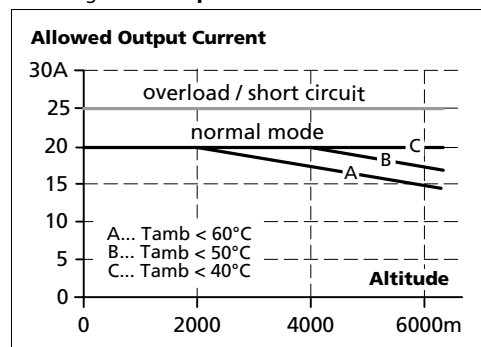

12. PROTECTION FEATURES

| | | |
|-----------------------------------|--------------|--|
| Output over-current protection | not included | |
| Reverse input polarity protection | included | unit does not start when input voltage is reversed |
| Degree of protection | IP 20 | EN/IEC 60529 |
| Penetration protection | > 3.6mm | e.g. screws, small parts |
| Over-temperature protection | not included | |
| Input transient protection | not included | |
| Output transient protection | included | see EMC section |
| Internal input fuse | not included | |

13. SAFETY FEATURES


| | | |
|--------------------------------|---|--|
| Input / output separation | no galvanic separation | 200V epitaxial diode between input and output |
| Safety level of output voltage | The output voltage is regarded to be SELV (EN 60950-1) or PELV (EN 60204-1, EN 50178, IEC 60364-4-41) if the input voltage and the voltage which is applied to the alarm contacts fulfills the requirements for a SELV source or PELV source. | |
| Class of protection | III | PE (Protective Earth) or chassis connection not required |
| PE resistance | < 0.10hm | between housing and chassis-ground terminal |

14. DIELECTRIC STRENGTH

The input and output voltages have the same reference, are floating and have no ohmic connection to ground. Type and factory tests are conducted by the manufacturer. Field tests may be conducted in the field using the appropriate test equipment which applies the voltage with a slow ramp (2s up and 2s down). Connect input/output/signal terminals together before conducting the test.





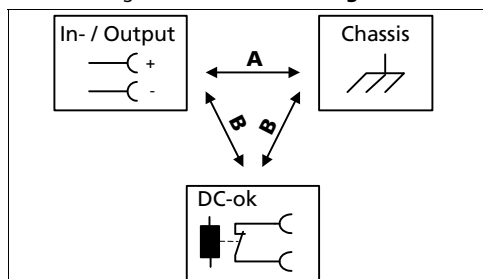





When testing, set the cut-off current settings to the value in the table below.

Fig. 14-1 Dielectric strength



| | | A | B |
|-------------------------|-----|----------|----------|
| Type test | 60s | 500Vac | 500Vac |
| Factory test | 5s | 500Vac | 500Vac |
| Field test | 5s | 500Vac | 500Vac |
| Cut-off current setting | | > 2mA | |

15. APPROVALS

| | | |
|--|---|---|
| EC Declaration of Conformity |  | The CE mark indicates conformance with the - EMC directive 2004/108/EC, - Low-voltage directive (LVD) 2006/95/EC and - RoHS directive 2011/65/EU. |
| EC Declaration of Conformity ATEX |  | The CE mark indicates conformance with the - ATEX directive 94/9/EC (Equipment and protection systems intended for use in potentially explosive atmospheres) |
| IEC 60950-1 |  | CB Scheme, Information Technology Equipment |
| UL 508 |  | Listed for use as Industrial Control Equipment; U.S.A. (UL 508); E-File: E198865 |
| UL 60950-1 |  | Recognized for use as Information Technology Equipment, Level 5; U.S.A. (UL 60950-1) and Canada (C22.2 No. 60950); E-File: E137006 |
| HazLoc (Class 1 Div 2) ANSI / ISA 12.12.01-2007 |  | LISTED for use in Hazardous Location Class I Div 2 T4 Groups A,B,C,D systems; U.S.A. (ANSI / ISA 12.12.01-2007) and Canada (C22.2 No. 213-M1987) |
| ATEX EN 60079-0, EN 60079-15 |  II 3G Ex nA nC IIC T4 Gc | Suitable for use in Category 3 Zone 2 locations. Number of ATEX certificate: EPS 11 ATEX 1 312 X The redundancy module must be built-in in an IP54 enclosure. |
| IECEX IEC 60079-0, IEC 60079-15 |  Ex nA nC IIC T4 Gc | Suitable for use in Category 3 Zone 2 locations. Number of IECEX certificate: IECEX EPS 12.0032X |
| Marine |  | GL (Germanischer Lloyd) classified and ABS (American Bureau for Shipping) PDA, Environmental category: C, EMC2, Marine and offshore applications |
| GOST R |  | Certificate of Conformity for Russia and other GUS countries |

16. PHYSICAL DIMENSIONS AND WEIGHT

| | |
|-------------------------|--|
| Weight | 350g / 0.77lb |
| DIN-Rail | Use 35mm DIN-rails according to EN 60715 or EN 50022 with a height of 7.5 or 15mm. The DIN-rail height must be added to the unit depth (117mm) to calculate the total required installation depth. |
| Installation clearances | See chapter 2 |

Fig. 16-1 **Front view**


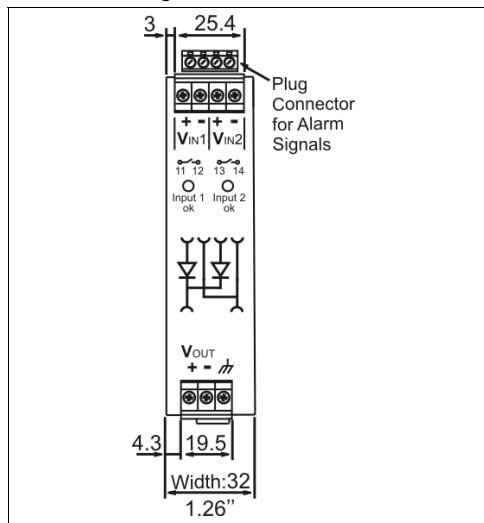


Fig. 16-2 **Side view**

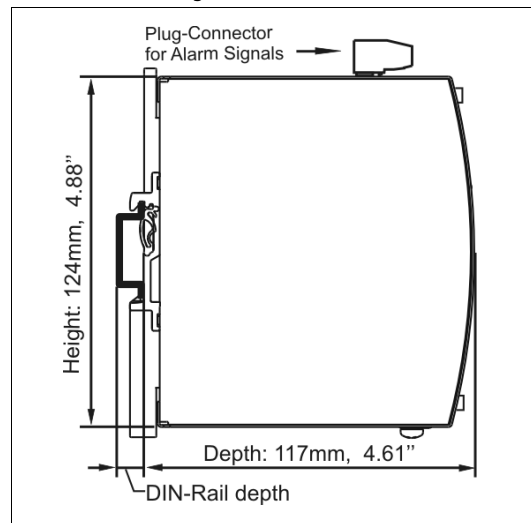

17. ACCESSORIES

ZM1.WALL Wall mounting bracket

This standard bracket is used to mount the YR40 redundancy module onto a flat surface without utilizing a DIN-Rail.

Fig. 17-1 ZM1.WALL Wall mounting bracket


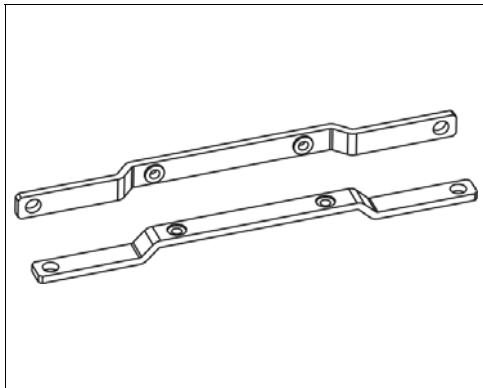


Fig. 17-2 Assembled wall mounting bracket

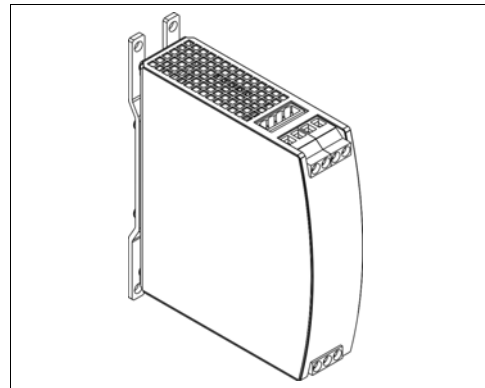

ZM11.SIDE Side mounting bracket

This bracket is used to mount the YR80 redundancy module sideways with or without utilizing a DIN-Rail.

The two aluminum brackets and the black plastic slider of the unit have to be detached, so that the steel brackets can be mounted.

For sideways DIN-rail mounting, the removed aluminum brackets and the black plastic slider need to be mounted on the steel bracket.

Fig. 17-3
ZM11.SIDE Side mounting bracket


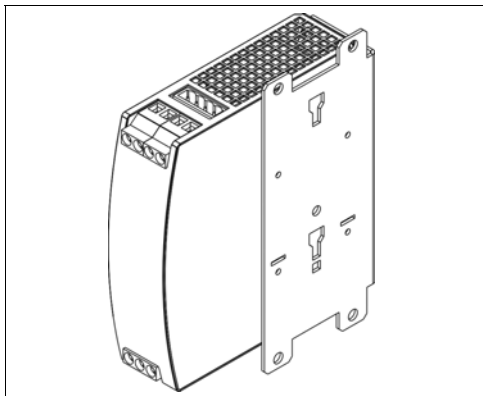


Fig. 17-4
Side mounting with DIN-rail brackets

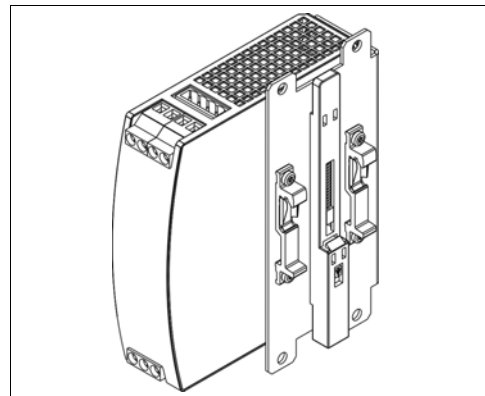

18. APPLICATION NOTES

18.1. RECOMMENDATIONS FOR REDUNDANCY

Recommendations for the configuration of redundant power systems:

- Use separate input fuses for each power supply.
- Use three-phase power supplies to gain functional safety if one phase fails.
- When single-phase power supplies are utilized connect them to different phases or mains circuits if possible.
- Set the power supply in "Parallel-Use" mode if this feature is available
- It is desirable to set the output voltages of all power supplies to the same value.


18.2. INDUCTIVE AND CAPACITIVE LOADS

The unit is designed to supply any kind of loads, including unlimited capacitive and inductive loads.

18.3. EXAMPLE: 1+1 REDUNDANCY UP TO 10A

1+1 Redundancy up to 10A requires two 10A power supplies and one YRM2.DIODE redundancy module.


Fig. 18-1 **Wiring diagram, 1+1 Redundancy, 10A output current**

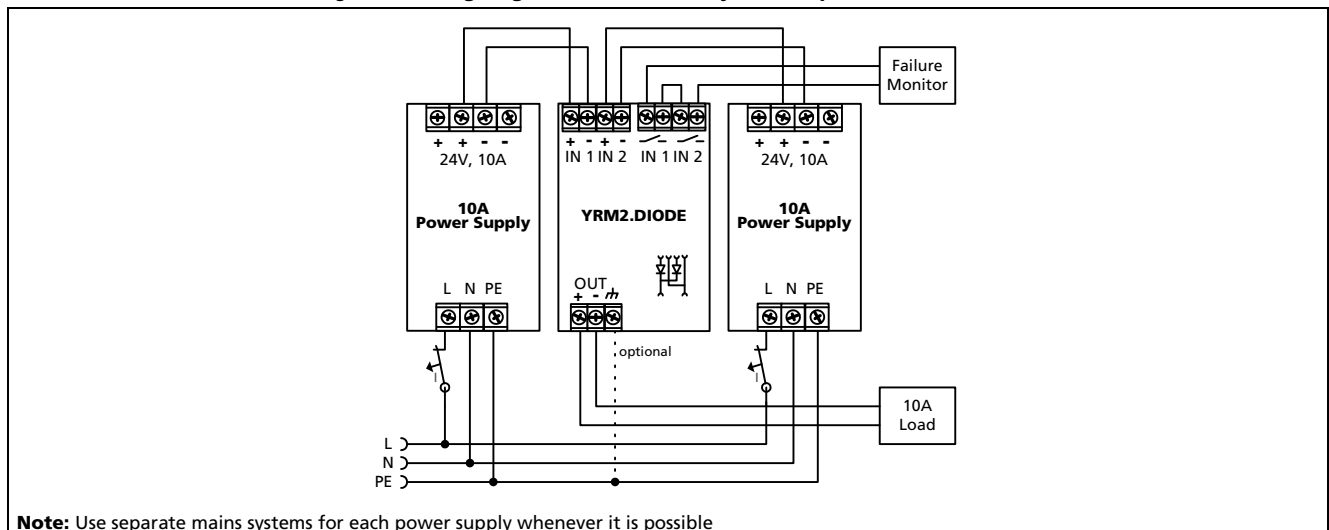

18.4. EXAMPLE: N+1 REDUNDANCY UP TO 30A

N+1 Redundancy up to 30A requires four 10A power supplies and two YRM2.DIODE redundancy modules.

Fig. 18-2 **Wiring diagram, n+1 Redundancy, 30A output current**

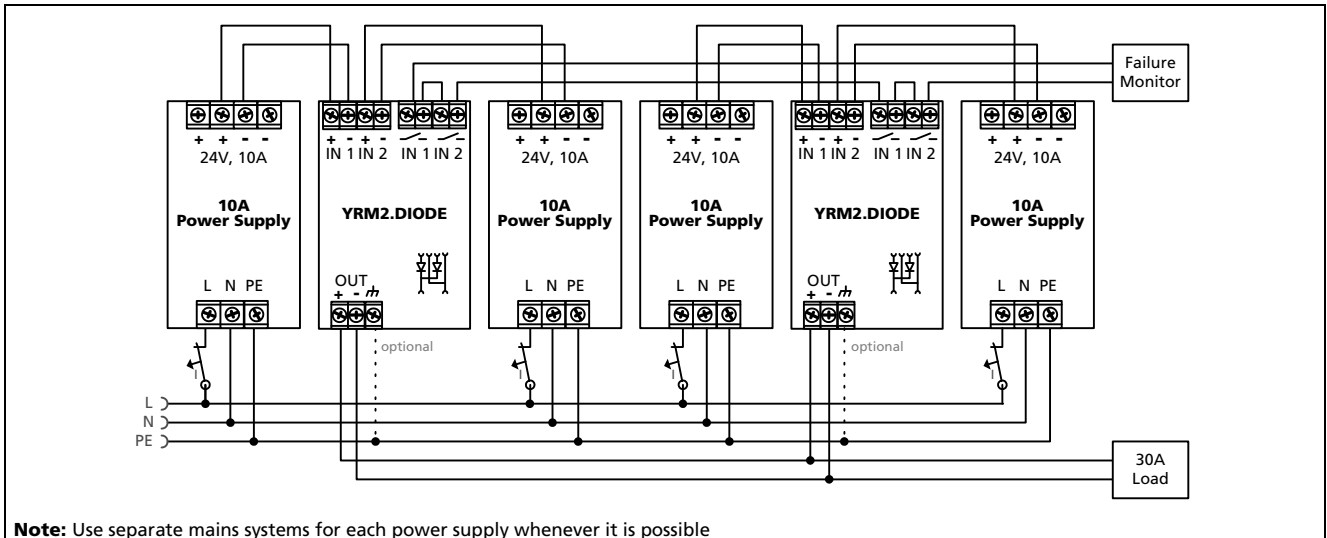


18.5. EXAMPLE: BATTERY BACK-UP

A battery back-up with 10A requires one 10A power supply and one YRM2.DIODE redundancy module.

Please note:

Set output voltage of power supply to 26.5Vdc minimum to ensure, that the load current is delivered from the power supply and not from charger (battery). Use a fuse between battery and YRM2.DIODE!

Fig. 18-3 **Wiring diagram, 10A Battery back-up**

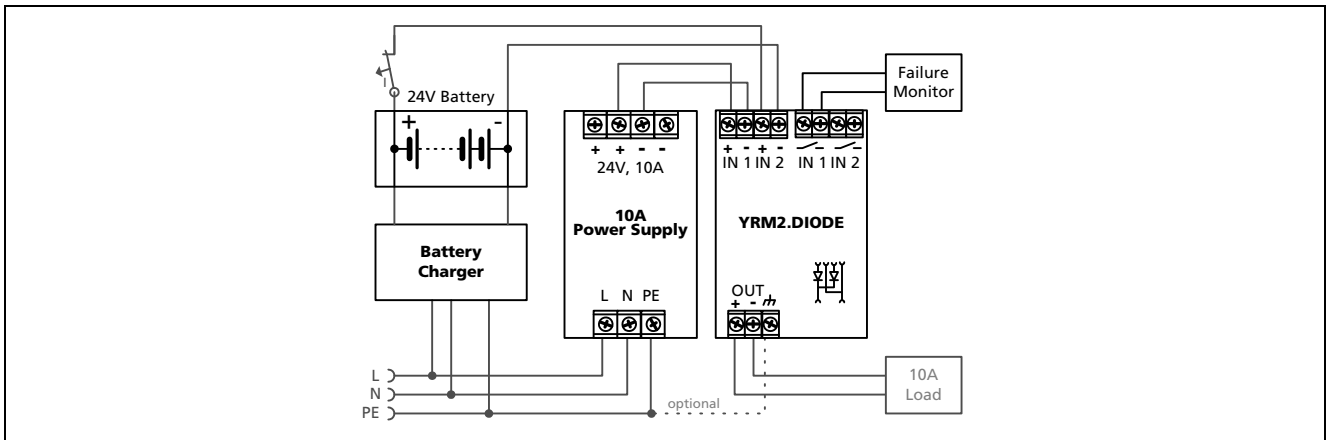


18.6. EXAMPLE: REDUNDANCY FOR CONTROLS

The example shows a cost effective solution to get redundant power for a PLC or controller system.

In many cases, two power supplies are used; one for the demanding loads and another one for the controls and sensitive loads. The power supply for the demanding loads can be used as a redundant source to supply the controls.

Traditional approach:



Improved approach:





Fig. 18-4 Wiring diagram, redundancy for sensitive loads

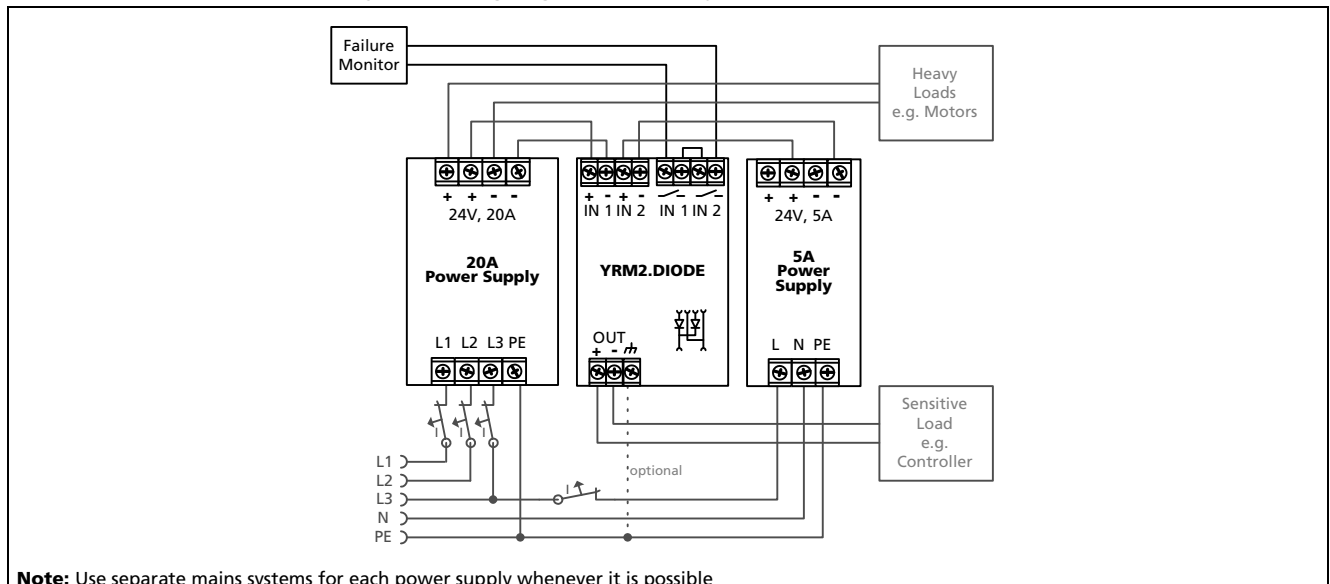

Note: Use separate mains systems for each power supply whenever it is possible


18.7. EXAMPLE: DECOUPLING OF BRANCHES

Buffer energy supplied from a DC-UPS or buffer module is not wasted in "power branches".

Please note:

Set output voltage of the power supply to a level that the buffer unit or DC-UPS will not start unexpectedly. Take the voltage drop of the YRM2.DIODE into account.

Fig. 18-5 **Wiring diagram, decoupling of buffered branches**

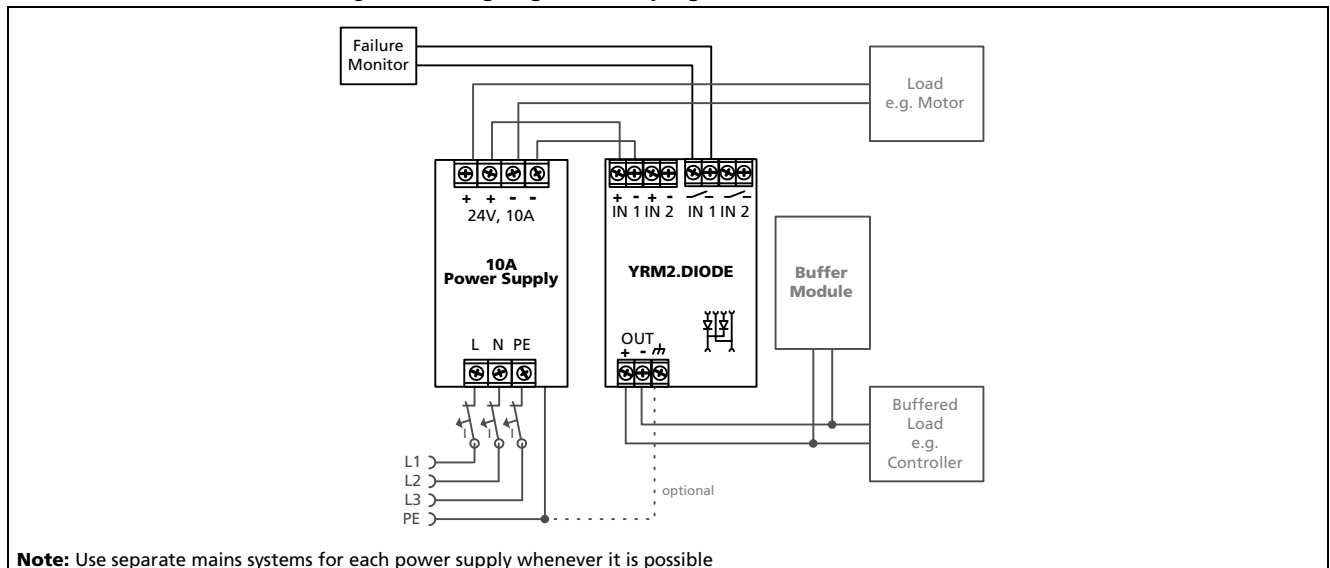

18.8. USE IN A TIGHTLY SEALED ENCLOSURE

When the redundancy module is installed in a tightly sealed enclosure, the temperature inside the enclosure will be higher than outside. The inside temperature defines the ambient temperature for the redundancy module.

Results from such an installation:

Power supply is placed in the middle of the box, no other heat producer inside the box

Enclosure: Rittal Typ IP66 Box PK 9516 100, plastic, 110x180x165mm

Load: 24V, 16A; (=80%) load is placed outside the box

Input: 24Vdc

Temperature inside enclosure: 58.8°C (in the middle of the right side of the power supply with a distance of 2cm)

Temperature outside enclosure: 24.6°C

Temperature rise: 34.2K

18.9. MOUNTING ORIENTATIONS

Mounting orientations other than input terminals on the bottom and output on the top require a reduction in continuous output power or a limitation in the maximum allowed ambient temperature.

Fig. 18-6
Mounting Orientation A
(Standard orientation)

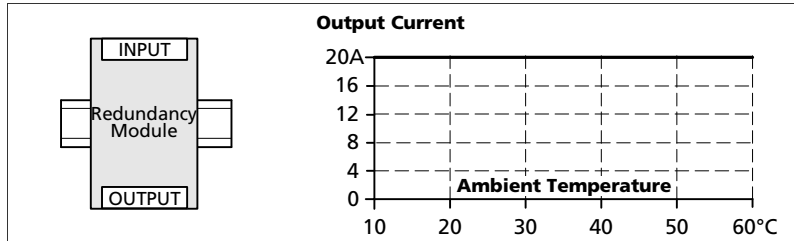


Fig. 18-7
Mounting Orientation B
(Upside down)

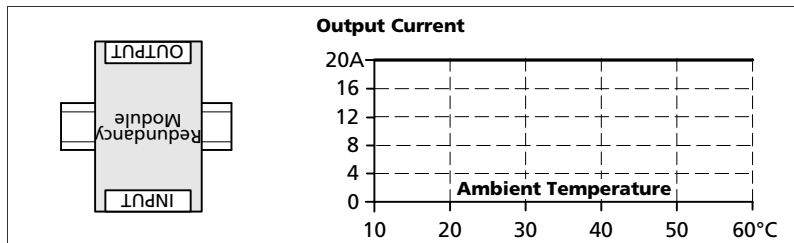


Fig. 18-8
Mounting Orientation C
(Table-top mounting)

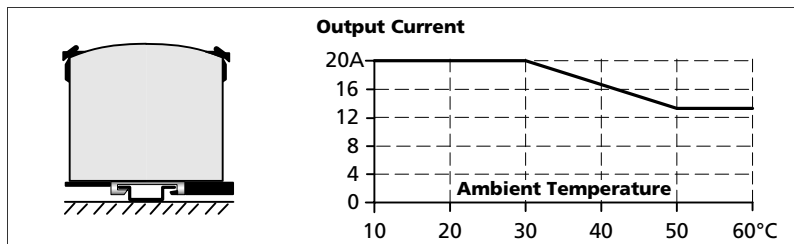


Fig. 18-9
Mounting Orientation D
(Horizontal cw)

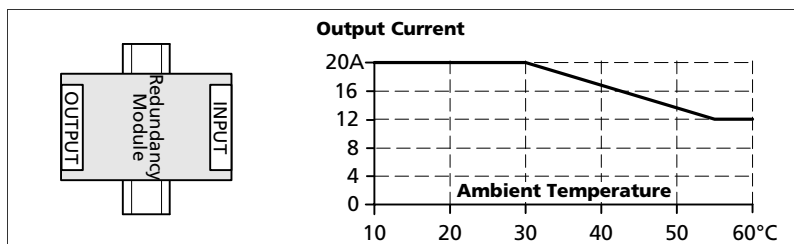


Fig. 18-10
Mounting Orientation E
(Horizontal ccw)

